Water and Sewer Notes

- 1. All water and sewer construction shall be in accordance with specifications and standard details of the Metro Water Services.
- 2. The contractor is responsible for reimbursing the metro water services the cost of
- 3. The contractor is to provide and maintain the construction identification sign for private development approved.
- 4. All connections to existing manholes shall be by coring and resilient connector
- Reduced pressure backflow prevention devices (rpbp) or dual check valve will be required on all test and fill lines (jumper) needed for water main construction and must be approved by the metro water services.
- 6. All water meters shall be a minimum of 24" not to exceed a maximum of 28" below
- 7. Pressure regulating devices will be required on the customer side of the meter when pressures exceed 100 psi.

Erosion Control and Grading Notes

unless otherwise noted within written specifications.

during and upon the completion of construction.

long and at least 6" thick.

the purpose of future landscape use.

portions of work which he is to perform.

Management Manual Volume 1 - Regulations.

a 22 unit Multi-Family residential development.

Metropolitan Department of Water Services.

standards, shall be constructed at street crossings.

(minimum driveway culvert in Metro right of way is 15" CMP).

vehicular access points not currently present or approved.

zoning district as of the date of the applicable request or application.

9. Individual water and/or sanitary sewer service lines are required for each lot.

10. Minor modifications to the preliminary SP plan may be approved by the Planning

floor area, add uses not otherwise permitted, eliminate specific conditions or

11. For any development standards, regulations and requirements not specifically shown on the SP plan and/or included as a condition of commission or council approval, the property shall be subject to the standards, regulations and requirements of the RM9

12. The final SP shall depict required public sidewalks, any required grass strip or frontage

zone and the location of all existing and proposed vertical obstructions within the

required sidewalk and grass strip or frontage zone. Prior to issuance of use and occupancy permits, existing vertical obstructions shall be located outside of the

required sidewalks. Vertical obstructions are only permitted within the required grass

the EPSC plan.

Standard SP Notes

sidewalk design standards.

strip or frontage zone.

to the issuance of a building permit.

dust within tolerable limits by sprinkling or other acceptable means.

stormwater management manual, volume four, section TCP-14.

1. Expose as small an area of soil as possible on the site for no more than 15 days. Keep

2. All cut/fill areas to have a minimum of 6" of topsoil cover. Areas dressed with topsoil

3. Erosion control barrier is called out on plans and is to comply with the Metropolitan

4. Disturbed areas are to be graded to drain as indicated in the plan to sediment barriers

5. The contractor shall be responsible for the verification and the location of any existing

6. Any access routes to the site shall be based with crushed stone, ASTM #1 stone, 100'

7. The placing and spreading of any fill material is to be started at the lowest point and

report). Said fill material is to be free of sod, roots, frozen soils, or any other

proctor, or as otherwise specified by the soils report or written specifications.

8. The contractor shall notify the Metro Davidson County department of Public Works construction compliance division, three days prior to beginning the work.

9. The contractor shall locate and stake the layout of the site in the field for inspection by

the engineer. The contractor shall check the grades and final dimensions on the

ground, and report any discrepancies to the engineer immediately for a decision.

10. Surplus excavation of topsoil shall be placed on the site as approved by the owner for

11. The contractor shall furnish and install all necessary temporary works for the protection

12. The contractor shall be responsible for any damage done to the premises or adjacent

premises or injuries to the public during the construction caused by himself, his

13. All work is to be completed with compliance to the rules and regulations set forth by

and pay fees required for the completion of his portion of the work. He shall also

comply with all city, county and state laws and ordinance or regulations relating to

14. All erosion control measures shall remain in place until site is stabilized & construction

location with NPDES department during the pre-construction meeting. Grading

16. The buffer along waterways will be an area where the surface is left in a natural state,

1. The purpose of this SP is to receive preliminary approval to permit the development of

accordance with Storm Water Management Ordinance No. 78-840 & Approved by the

2. Any excavation, fill or disturbance of the existing ground elevation must be done in

3. This Property does Not Lie Within a Flood Hazard Area as Depicted on the Current

Flood Insurance Rate Maps (FIRM) Numbers 47037CO403H dated 4/5/2017.

4. All public sidewalks are to be constructed in conformance with metro public works

5. Wheel chair accessible curb ramps, complying with applicable metro public works

6. The required fire flow shall be determined by the metropolitan fire marshal's office, prior

7. Size driveway culverts per the design criteria set forth by the Metro Stormwater Manual

8. Metro Water Services shall be provided sufficient & unencumbered ingress & egress at

all times in order to maintain, repair, replace & inspect any stormwater facilities within

Commission or its designee based upon final architectural, engineering or site design and actual site conditions. All modifications shall be consistent with the principles and

further the objectives of the approved plan. Modifications shall not be permitted, except through an ordinance approved by Metro Council that increase the permitted density or

requirements contained in the plan as adopted through this enacting ordinance, or add

15. Contractor to provide an area for concrete wash down and equipment fueling in

Metro Water Services. The contractor shall give all necessary notice, obtain all permits,

accordance with metro CP-10 and CP-13, respectively. Contractor to coordinate exact

permittee to include bmp's designed to control site wastes such as discarded building

materials, chemicals, litter and sanitary wastes that may cause adverse impacts to

water quality. The location of and/or notes referring to said bmp's shall be shown on

and is not disturbed by construction activity. This is in accordance with the Stormwater

of the public and employees, including warning signs and lights.

sub-contractors, or the carelessness of any of his employees.

will be accomplished as per the current specification governing such work.

utilities. It shall be the responsibility of the contractor to avoid damage to all existing

utilities during construction. If damage does occur to any such installation, full repair

brought up in horizontal layers of 8" thickness (or as directed by the soils investigative

decomposable material. Said fill is to be compacted to a minimum of 95% standard

shall receive 12 lbs. per 1000 sq. ft. of 10-10-10 fertilizer (unless otherwise specified in

written specifications), 5 lbs. or more of Kentucky 31 fescue seed per 1000 sq. ft., and

a straw mulch cover of 70%-80% coverage (approximately 125 lbs. per 1000 sq. ft.),

- 8. Pressure regulating devices will be required on the street side of the meter when pressures exceed 150 psi.
- 9. After completion of the sanitary sewer, the developer is responsible for the televising of the lines prior to final acceptance. The videotaping must be coordinated with the Metro Water Services inspection section. All costs will be borne by the developer.
- 10. Upon completion of construction of water and/or sewer, the engineer shall provide the Metro Water Services department with a complete set of as-built plans on moist erasable mylars in reverse and in digital (*.dwg) format. Sewer plans shall be sealed by a licensed professional engineer or a registered land surveyor and shall include actual field angles between lines, all actual service lines and tee locations, the distance of the end of the service line to property corners and lines and/or station and offset from sewer centerline to end of service line, the depth to the top of the end of the service line, and shall reflect all alignment and grade changes. Water line plans shall be sealed by a licensed professional engineer or a registered land surveyor and shall include offset distance from the roadway centerline, or property line right of way, line depth, locations of hydrants, valves, reducers, tees and pressure reducing devices where applicable. all drawings must be completed and submitted prior to acceptance of the sewers or water mains into the public system and any connections being made.
- 11. All water mains must be located within the paved area including all blow-off assemblies.

Landscape Notes

- 1. The landscape contractor shall coordinate all construction with the appropriate utility company and shall be responsible for and damage to utilities. the landscape contractor shall verify the exact location of all utilities and take precautions to prevent damage to the utilities.
- 2. All planting and mulch beds shall be sprayed with round-up (contractor's option) prior to the installation of mulch.
- 3. Plant materials and stumps indicated for removal shall be removed and disposed off-site by the contractor. Backfill holes with topsoil free of roots and rocks.
- 4. The landscape contractor shall be responsible for the fine grading of all planting
- 5. All planting areas shall be fertilized with 12#/1000 s.f. of 10-10-10 fertilizer.
- 6. All planting beds shall have a minimum of 3" depth of shredded hardwood bark mulch.
- 7. The landscape contractor shall verify all material quantities. In the event of a discrepancy, the quantities shown on the plan will take precedence.
- 8. The landscape contractor shall provide the owner with written instructions on the proper care of all specified plant materials prior to final payment.
- 9. Existing trees to remain shall be protected from construction damage. Selectively
- 10. All disturbed areas shall be planted with turf as indicated on the materials schedule.
- 11. All deciduous trees, existing and proposed shall be pruned to provide 4' minimum clear trunk unless otherwise noted.
- 12. The landscape contractor shall provide a one year warranty on all plant materials and replace any dead or dying material within that time period.
- 13. No plant materials should be substituted without authorization by Dale & Associates. Plant sizes shown are minimums required by the local municipality and materials shown have been selected specifically for this project.
- 14. All wire baskets shall be completely removed and disposed of, burlap should be removed or punctured in at least 5 places. Remove all twine from burlapped
- 15. Guying is not allowed unless required by municipality or site conditions. The landscape contractor shall remove wires after a one year period.
- 16. No canopy tree shall be located within 15' of an overhead utility. No tree shall be located within a public utility easement. Locating plant materials within a drainage easement is acceptable, but only if installed as not to disturb existing drainage flow. In such instances, the materials shall be located no closer than 5' from the centerline of drainage.
- 17. Lighting plan to be coordinated with proposed planting plan. no light poles to be located in tree islands. See lighting plan for proposed light locations.

Public Works Notes

- 1. All work within the public right of way requires an excavation permit from the department of public works.
- 2. Proof-rolling of all street subgrades is required in the presence of the public works inspector. Inspection of the binder course is required prior to final paving in the presence of the public works inspector. These requests are to be made 24 hours in
- 3. Stop signs are to be 30 inch by 30 inch.
- 4. Street signs to have six inch white letters on a nine inch green aluminum blade, high intensity reflective.
- 5. All pavement marking are to be thermoplastic.

Architectural Notes


Building elevations for all street facades shall be provided with the final site plan. The following standards shall be met:

- A. Building facades fronting a street and courtyard shall provide a minimum of one principal entrance (doorway) and a minimum of 25% glazing.
- B. Windows shall be vertically oriented at a ration of 1.5:1 or greater.
- C. EIFS, vinyl siding, and untreated wood shall be prohibited
- D. A raised foundation of 18"-36" is required for all residential structures.
- E. Porches shall provide a minimum of six feet of depth.

Preliminary SP

Anderson Road

Map 150 Parcel 19 Nashville, Davidson Co., Tennessee Case # 2018SP-040-001

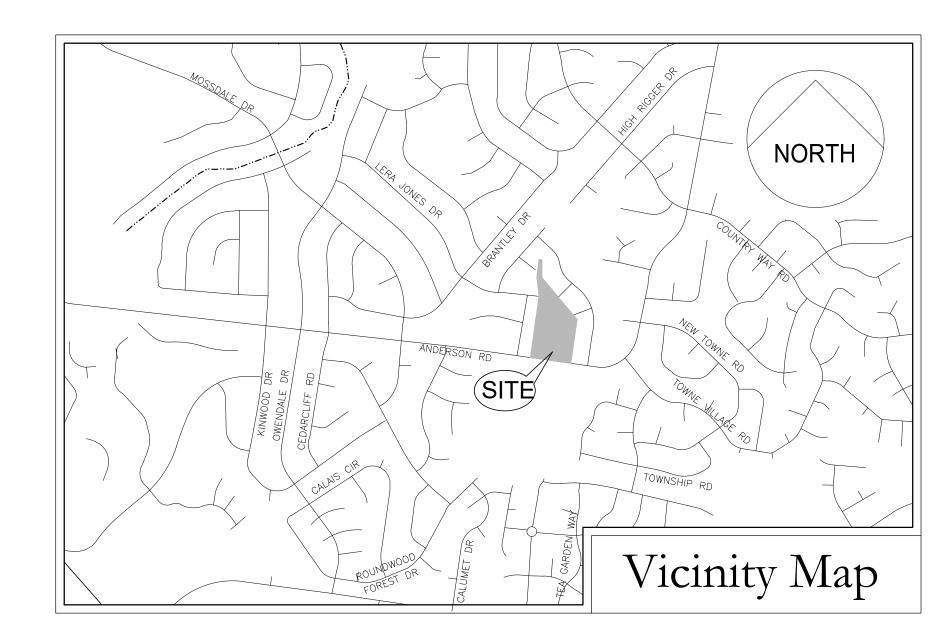

SHEET SCHEDULE

C0.0	Project Notes and Standards
C1.0	Existing Conditions Plan
C2.0	Layout and Utility Plan
C3.0	Grading and Drainage Plan

Development Summary

Property Information Map 150 Parcel 19 3156 Anderson Rd. Antioch TN, 37013 Zoned: AR2A Site Area: 4.88 Ac Council District 29 - Delishia Porterfield

Email:jec15@comcast.net

This Property does Not Lie Within a Flood Hazard Area as Depicted on the Owners of Record / Developer Current Flood Insurance Rate Maps Coleman, John E. Jr. (FIRM) Number 47037CO403H dated 3156 Anderson Rd. 4/5/2017. Antioch TN, 37013 Phone:615.293..0199

Benchmark Capped 5/8" Iron Rod Elev: 566.24

516 Heather Place

615.297.5166

Floodnote

Civil Engineer and Surveyor

Nashville, Tennessee 37204

Dale & Associates (Adam Seger, PE)

Electric Service Nashville Electric Service (NES) 1214 Church Street Nashville, Tennessee 37246 615.747.6807

Gas Service Nashville Gas (Piedmont) 615.734.0734

Water and Sewer Service Metro Water Service 1600 2nd Avenue North Nashville, TN 37208

Telephone Service 866.620.6000

Utility Location Tennessee One-Call 800.351.1111


615.862.4598

Specific Plan Development Summary This SP allows for the following: 22 Multi-Family Units 212,707 sq ft or 4.88 Acres Project Area Property zoning: AR2A Surrounding Zoning: R10 Minimum lot size Number of Residential Units/Density 22 units / 4.5 units per acre 0.70 max Street Setbacks 15' measured from R.O.W. Side yard 3' min. Perimeter 20' measured from Property Line Rear yard Height standards 45' Maximum Overall Height Parking and Access (1) - 38th Avenue North Ramp Location and Number Distance to nearest existing ramp (Min. 3 38th Ave North - 320 to the south Distance to intersection Charlotte Ave - 720 to the south Required Parking 40 stalls, Min 2 spaces per unit Provided Parking 48 covered stalls





PERMITS: Case # 2018SP-040-001 **D&A Project #16210** Anderson Rd

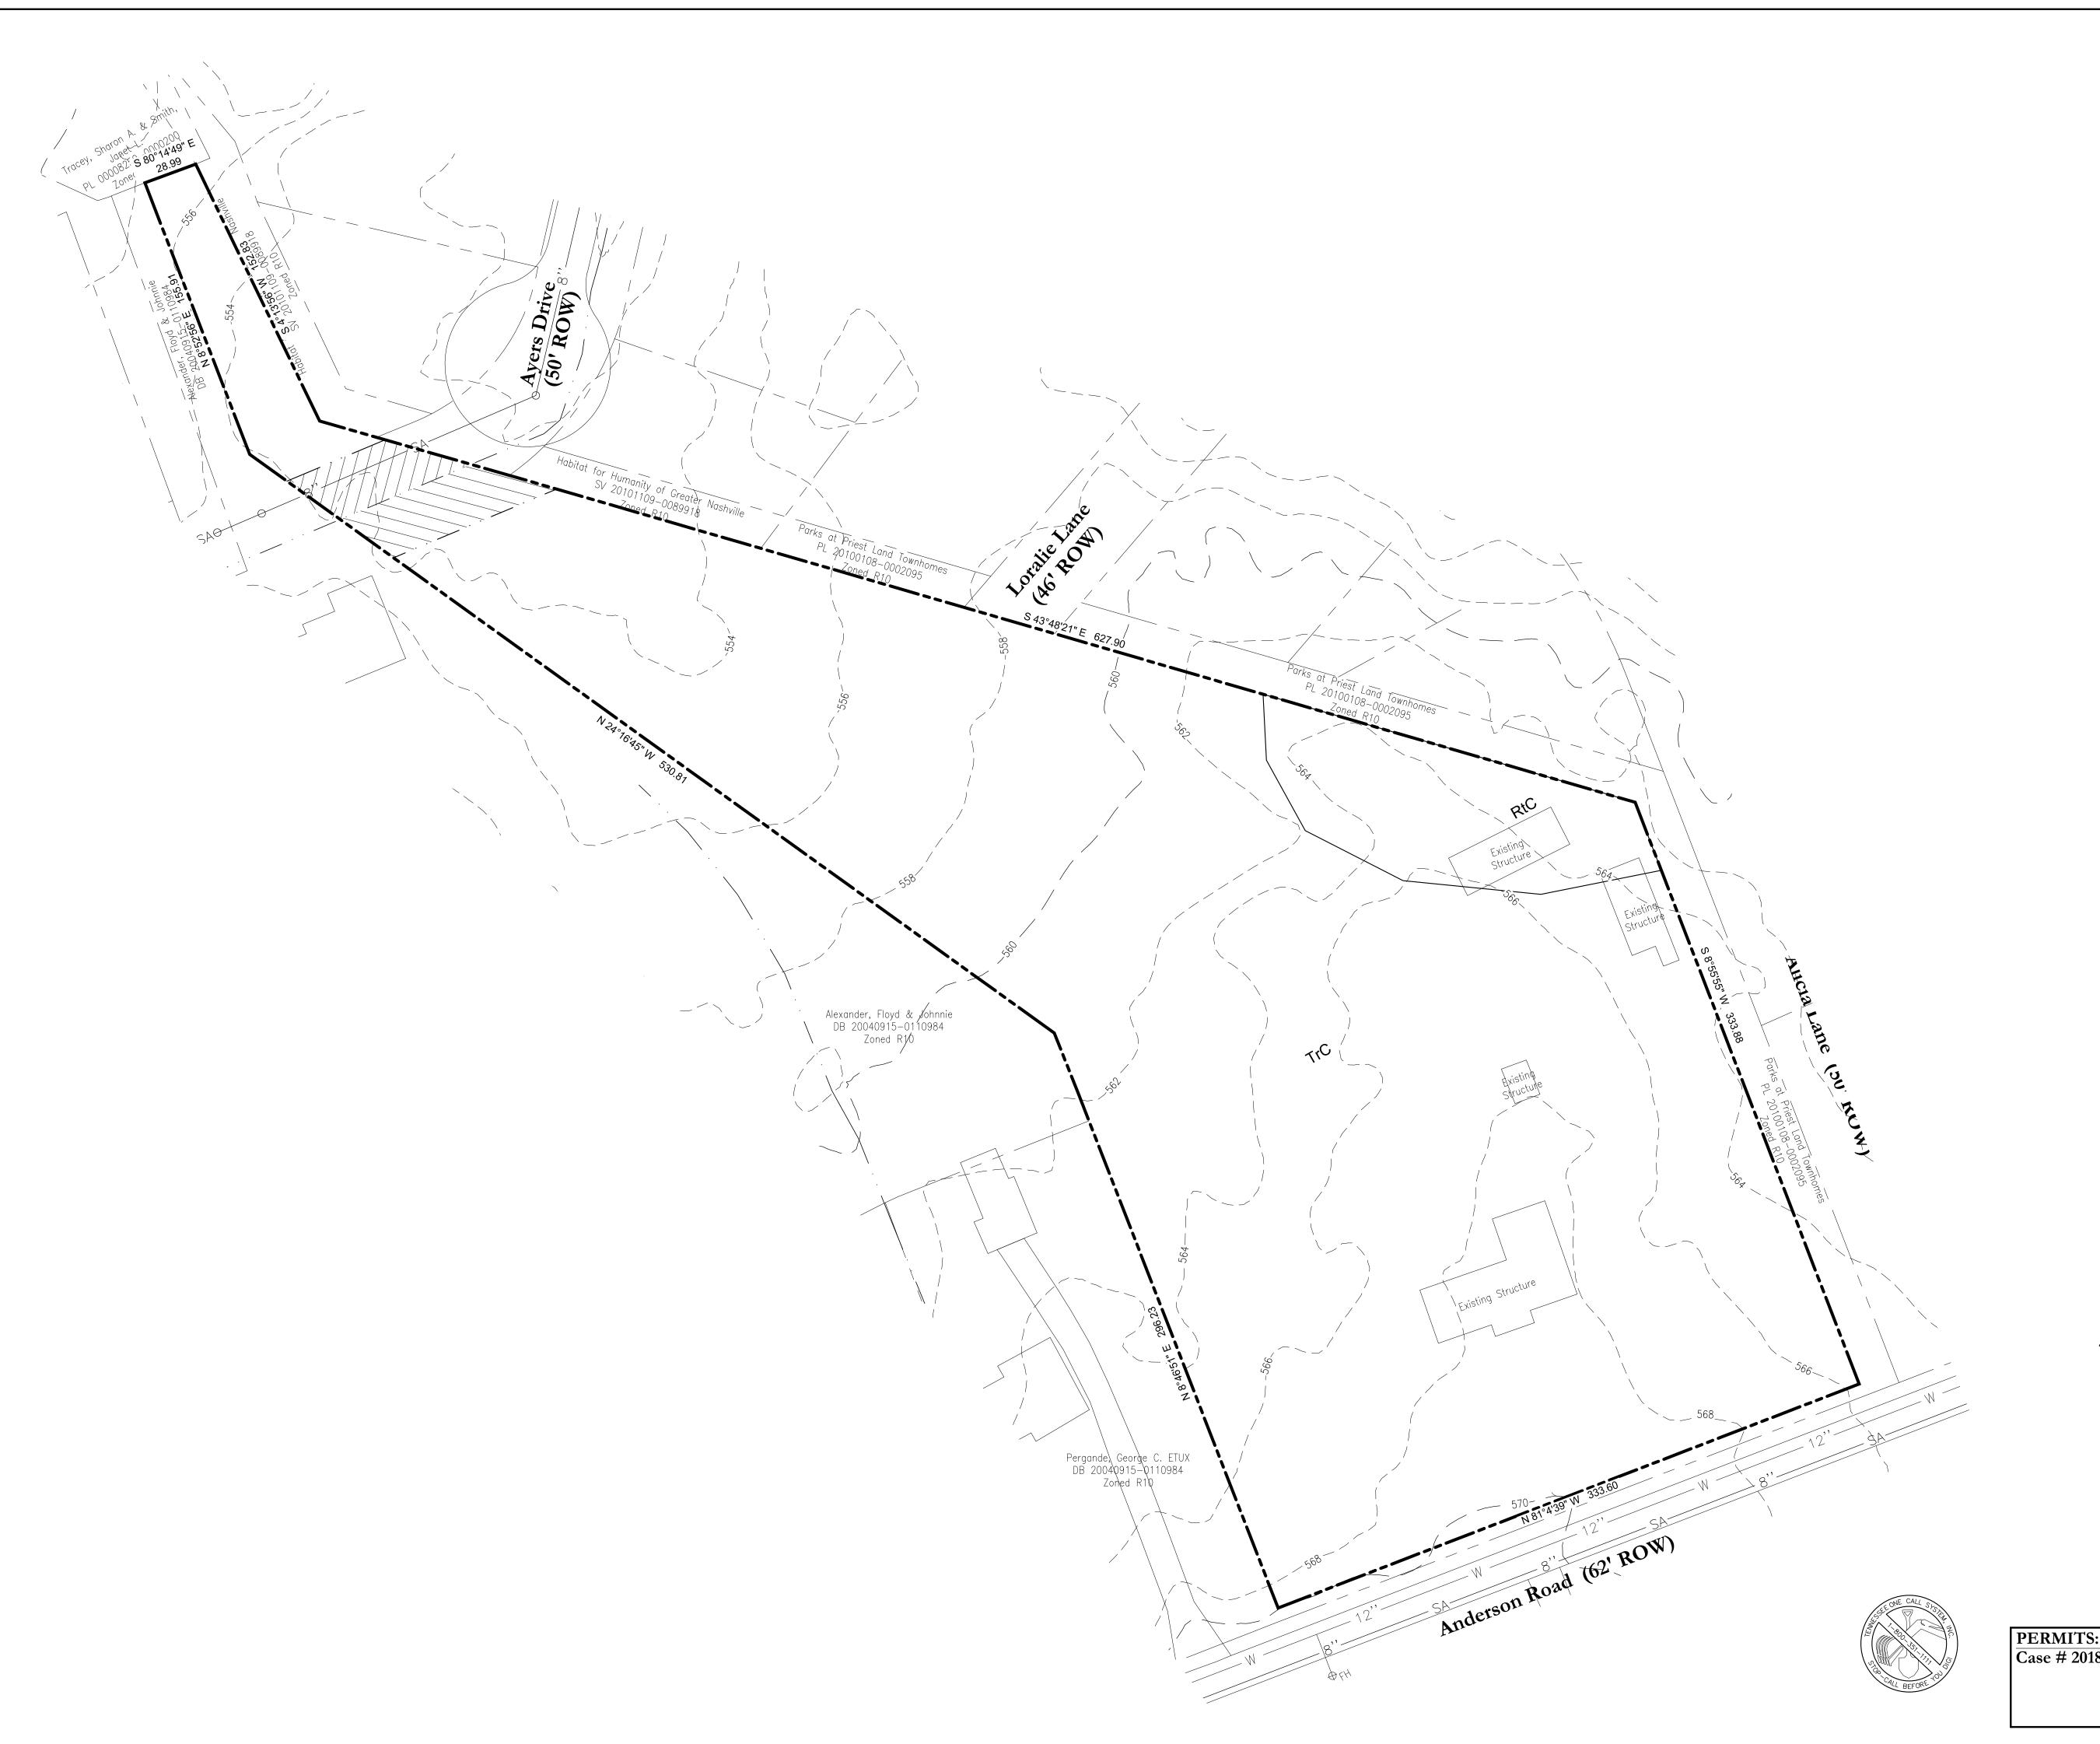

Development Summary

Property Information
Map 150 Parcel 19
3156 Anderson Rd.
Antioch TN, 37013
Zoned: AR2A
Site Area: 4.88 Ac Council District 29 - Delishia Porterfield

Owners of Record / Developer Coleman, John E. Jr. 3156 Anderson Rd. Antioch TN, 37013 Phone:615.293..0199 Email:jec15@comcast.net

Civil Engineer and Surveyor
Dale & Associates (Adam Seger, PE)
516 Heather Place
Nashville, Tennessee 37204
615.297.5166

Floodnote

This Property does Not Lie Within a Flood Hazard Area as Depicted on the Current Flood Insurance Rate Maps (FIRM) Number 47037CO403H dated 4/5/2017.

Benchmark Capped 5/8" Iron Rod Elev: 566.24

Drawing Date:
March 28, 2018

Revisions

Road SP

nderson 156

3

Existing Conditions Plan

PERMITS: Case # 2018SP-040-001

Scale 1" = 40'

D&A Project #16210 Anderson Rd

