



February 29, 2024

To: Peggy Deaner Metro Water Services

Re: **Amend BL2022-1096-804 14<sup>th</sup> Ave. N.  
Planning Commission Mandatory Referral 2022M-010ES-002  
Council District #19 Jacob Kupin Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

*A request to amend Council BL2022-1096 and Proposal No. 2022M-010ES-001 to decrease the linear feet of water main being abandoned and accepted, to remove the acceptance of a fire hydrant assembly, and to accept steel casing pipe.*

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

**Conditions that apply to this approval: none**

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at [Delilah.Rhodes@nashville.gov](mailto:Delilah.Rhodes@nashville.gov) or 615-862-7208


Sincerely,

A handwritten signature in blue ink that reads "Lisa Milligan".

Lisa Milligan  
Assistant Director Land Development  
Metro Planning Department  
cc: *Metro Clerk*

**Re: Amend BL2022-1096-804 14<sup>th</sup> Ave. N.  
Planning Commission Mandatory Referral 2022M-010ES-002  
Council District #19 Jacob Kupin Council Member**

*A request to amend Council BL2022-1096 and Proposal No. 2022M-010ES-001 to decrease the linear feet of water main being abandoned and accepted, to remove the acceptance of a fire hydrant assembly, and to accept steel casing pipe.*

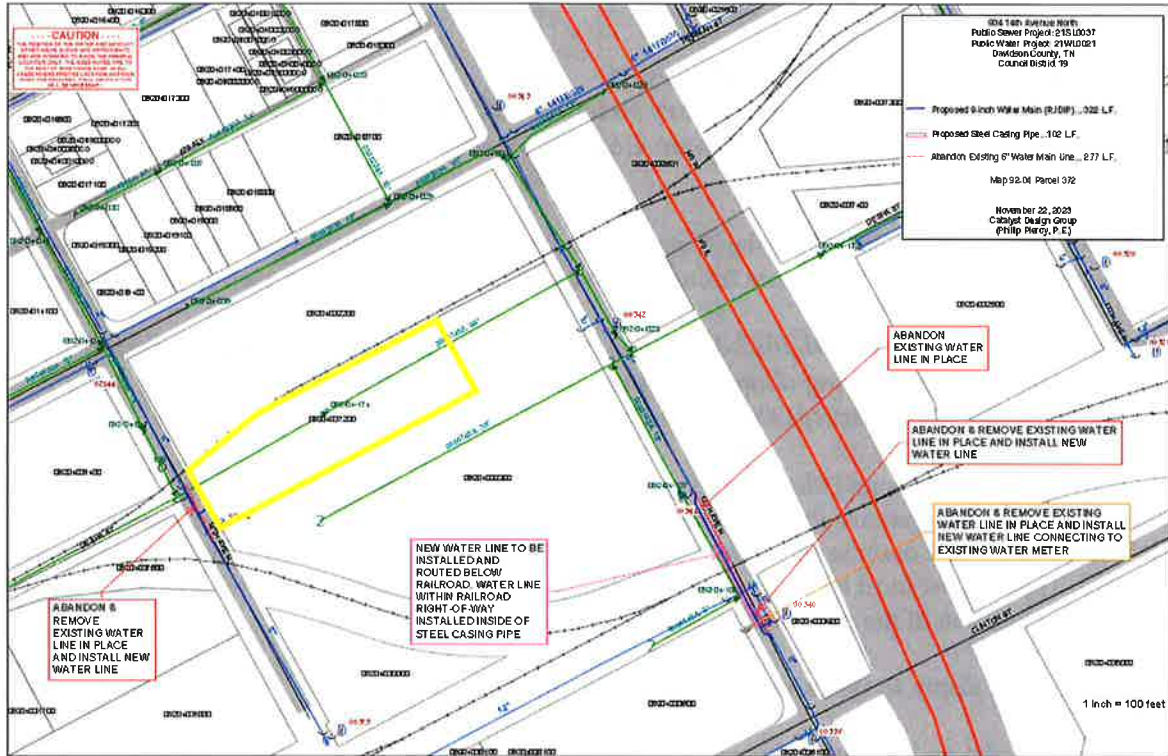


**----- CAUTION -----**  
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

804 14th Avenue North  
Public Sewer Project: 21SL0037  
Public Water Project: 21WL0021  
Davidson County, TN  
Council District 19

Proposed 8-inch Water Main (RJDIP)... 322 L.F.  
Proposed Steel Casing Pipe... 102 L.F.  
Abandon Existing 6" Water Main Line... 277 L.F.

Map 92-04 Parcel 372

November 22, 2023  
Catalyst Design Group  
(Phillip Piercy, P.E.)

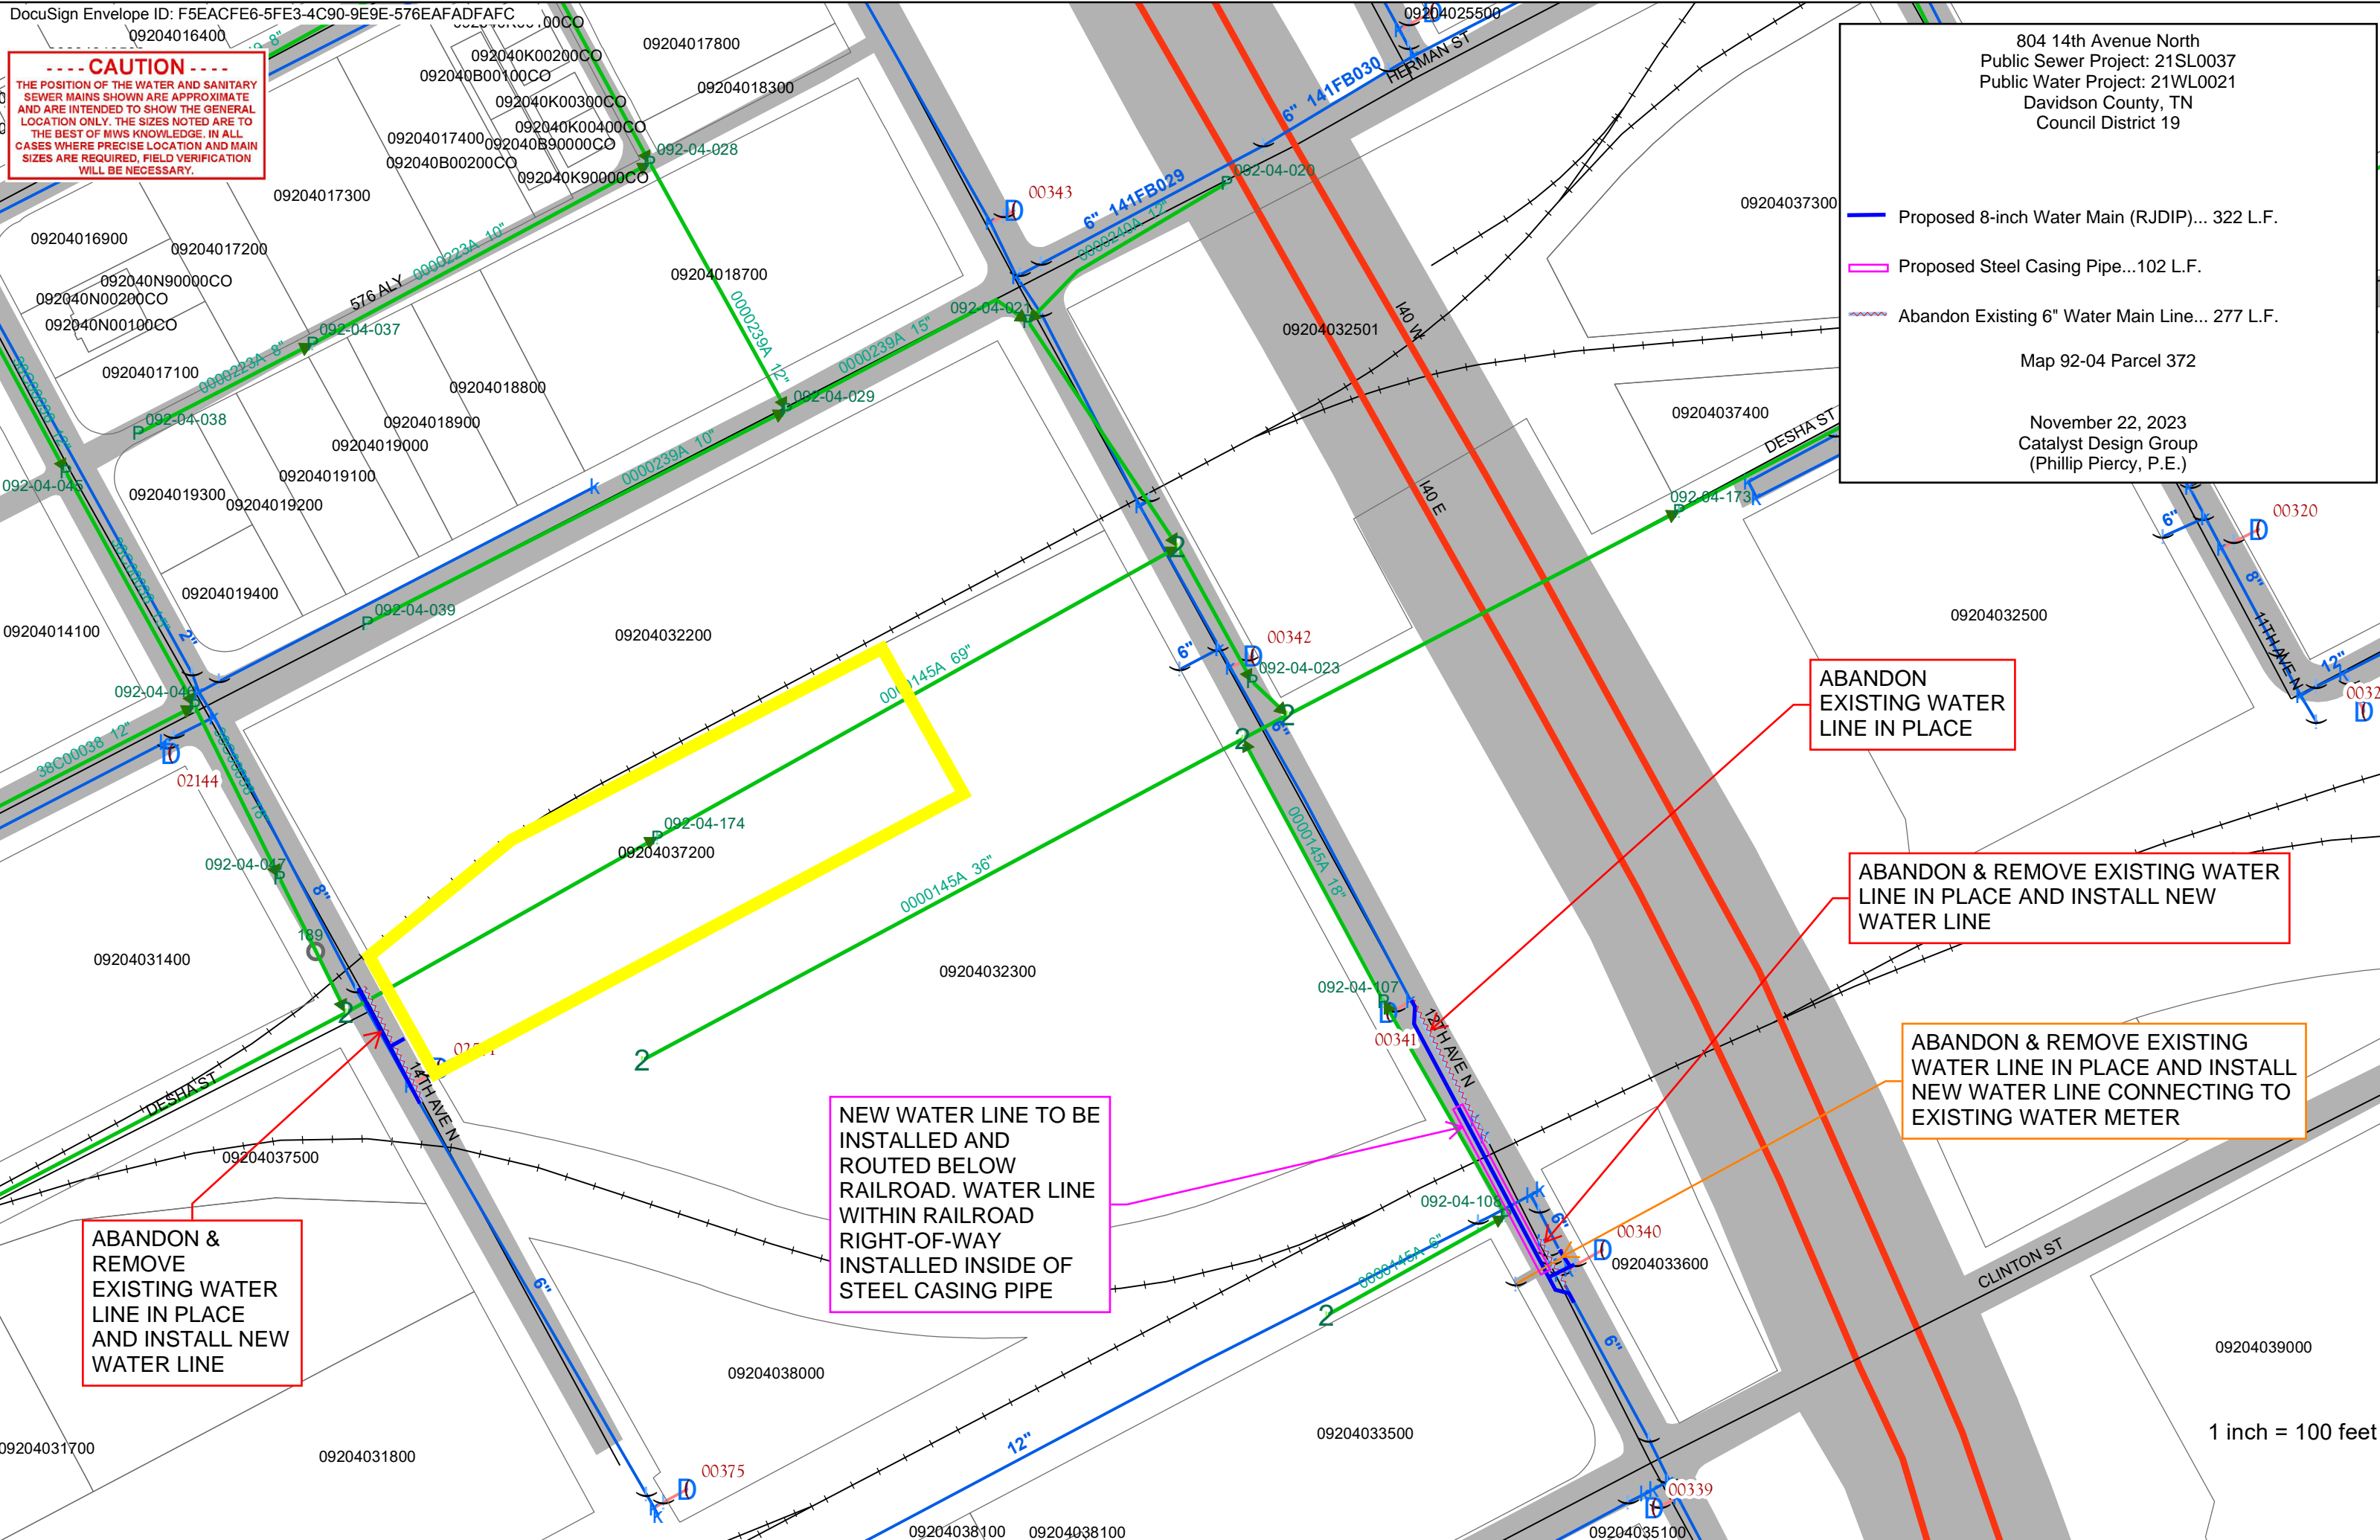

ABANDON EXISTING WATER LINE IN PLACE

ABANDON & REMOVE EXISTING WATER LINE IN PLACE AND INSTALL NEW WATER LINE

ABANDON & REMOVE EXISTING WATER LINE IN PLACE AND INSTALL NEW WATER LINE CONNECTING TO EXISTING WATER METER

ABANDON & REMOVE EXISTING WATER LINE IN PLACE AND INSTALL NEW WATER LINE

NEW WATER LINE TO BE INSTALLED AND ROUTED BELOW RAILROAD. WATER LINE WITHIN RAILROAD RIGHT-OF-WAY INSTALLED INSIDE OF STEEL CASING PIPE

1 inch = 100 feet