


**----- CAUTION -----**  
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MINS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

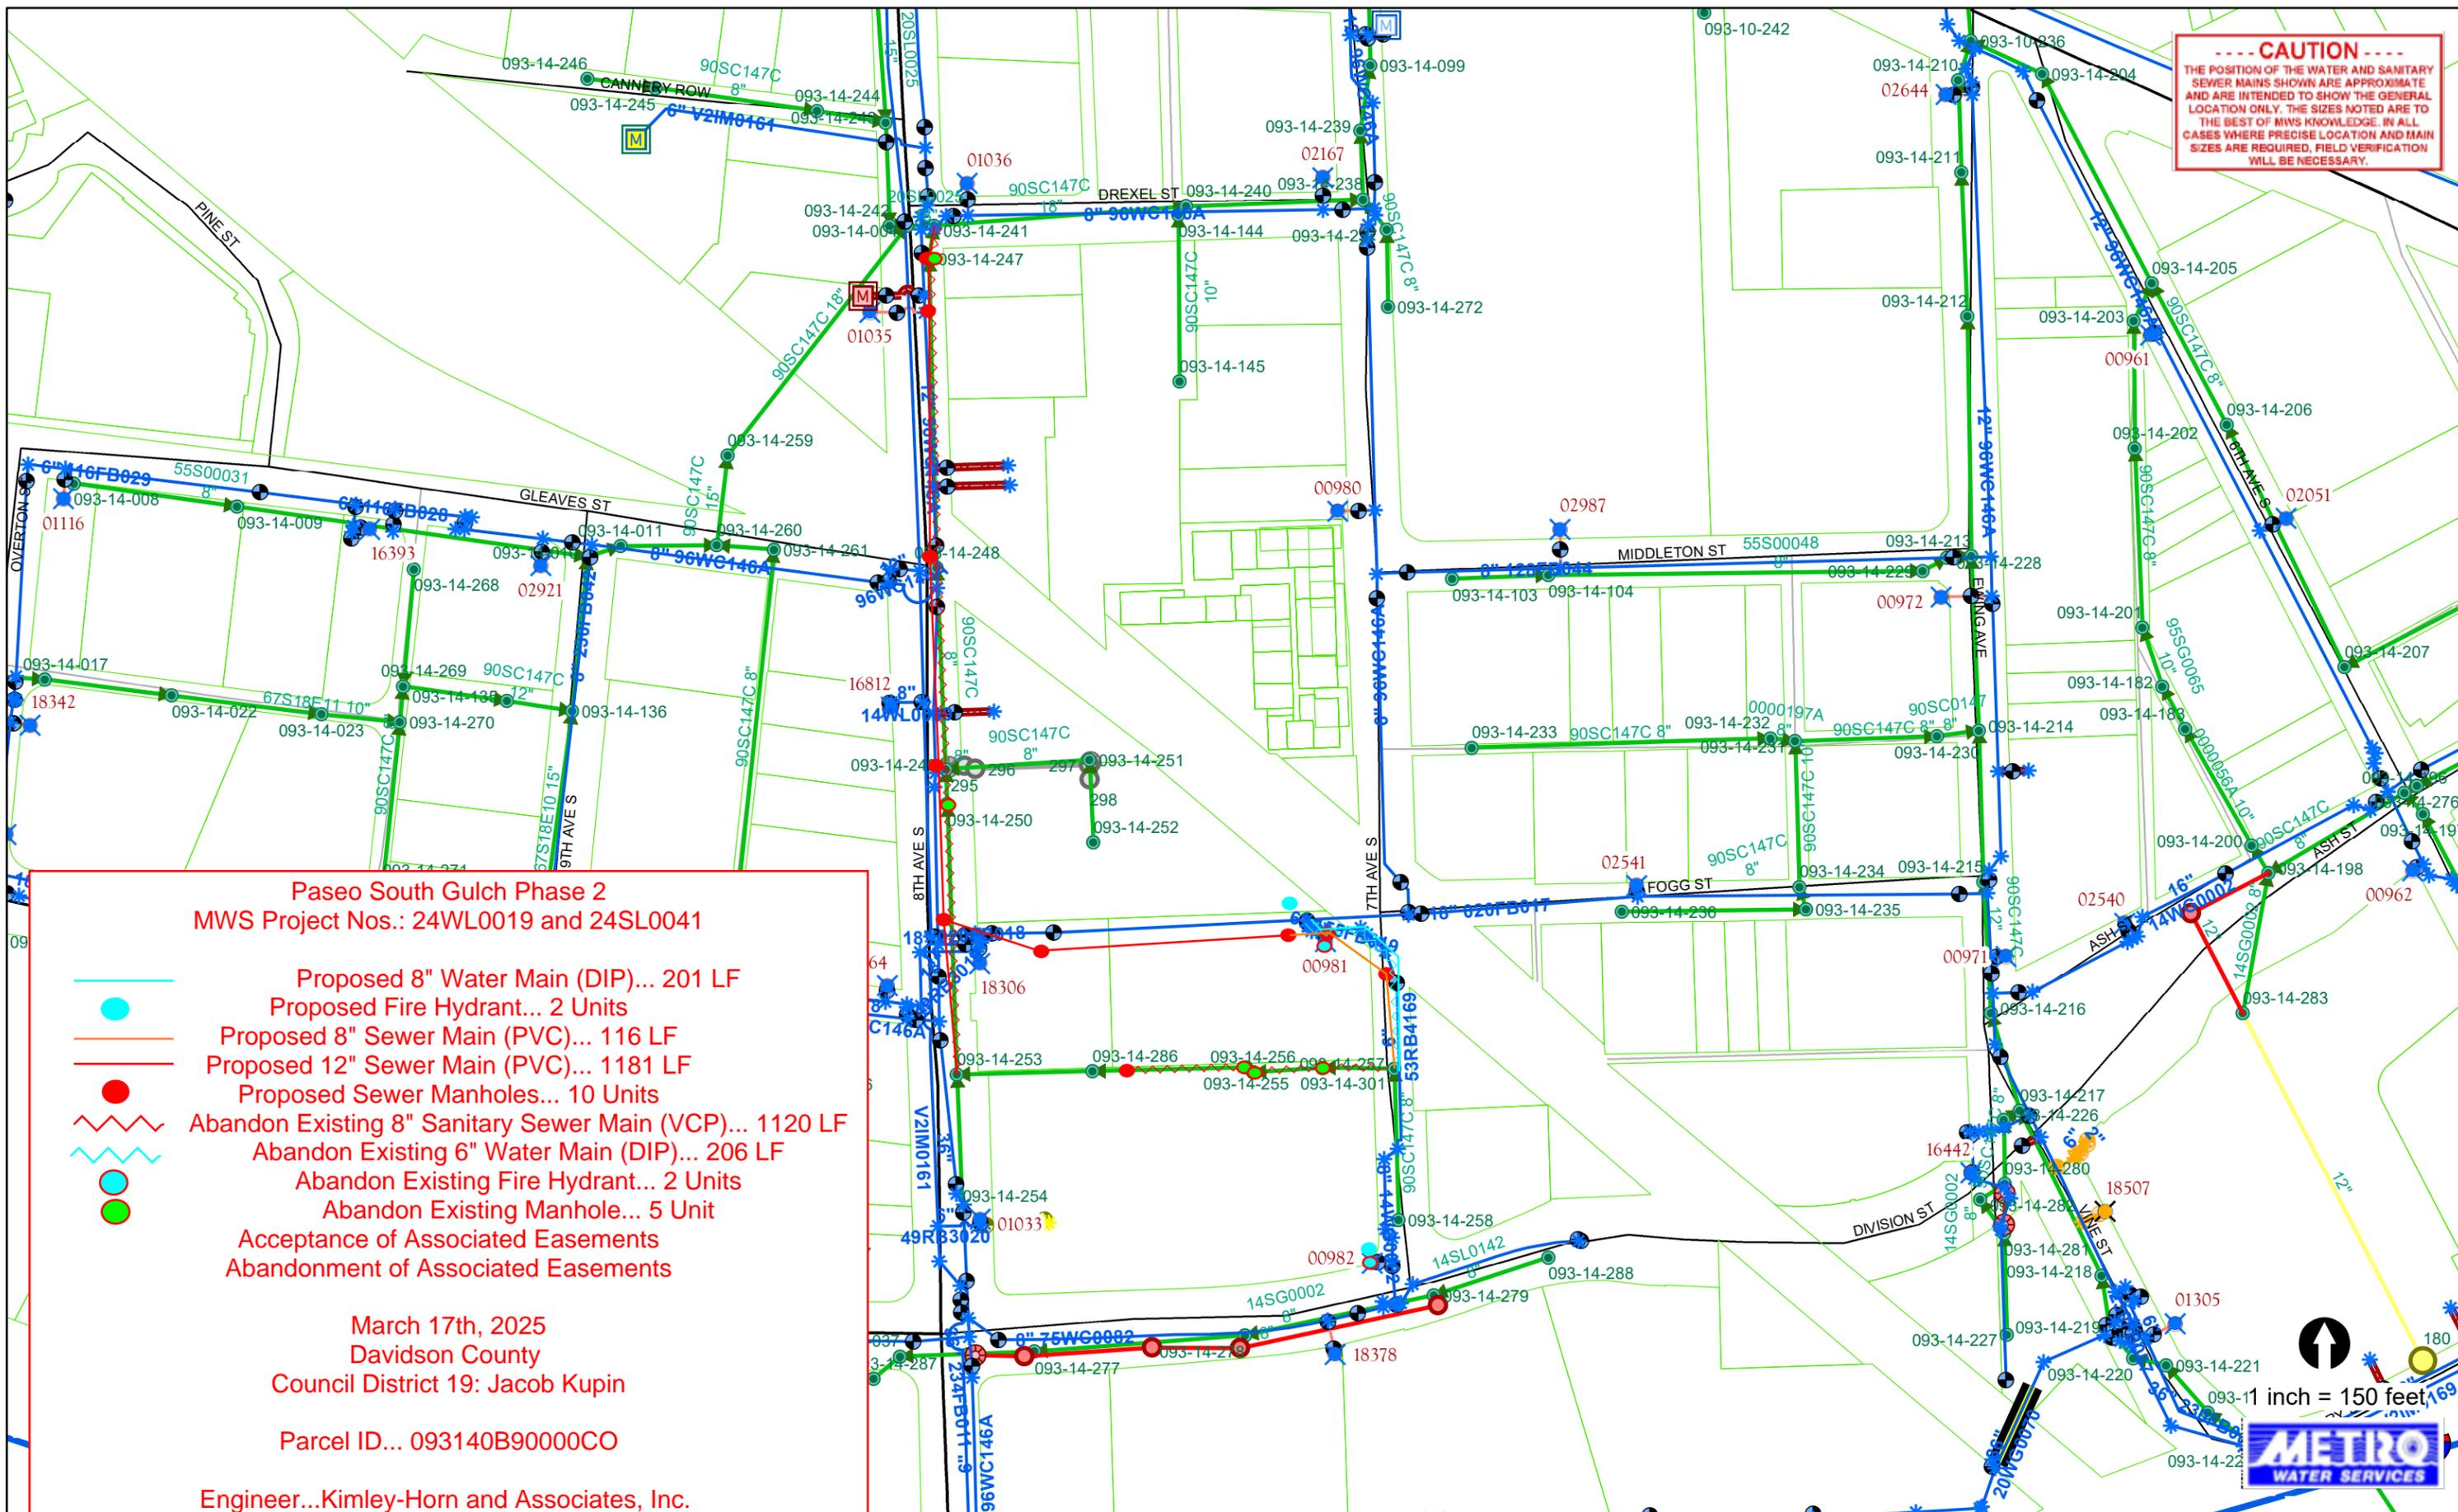

**Paseo South Gulch Phase 2**  
 MWS Project Nos.: 24WL0019 and 24SL0041

-  Proposed 8" Water Main (DIP)... 201 LF
-  Proposed Fire Hydrant... 2 Units
-  Proposed 8" Sewer Main (PVC)... 116 LF
-  Proposed 12" Sewer Main (PVC)... 1181 LF
-  Proposed Sewer Manholes... 10 Units
-  Abandon Existing 8" Sanitary Sewer Main (VCP)... 1120 LF
-  Abandon Existing 6" Water Main (DIP)... 206 LF
-  Abandon Existing Fire Hydrant... 2 Units
-  Abandon Existing Manhole... 5 Unit
-  Acceptance of Associated Easements
-  Abandonment of Associated Easements

March 17th, 2025  
 Davidson County  
 Council District 19: Jacob Kupin

Parcel ID... 093140B90000CO

Engineer... Kimley-Horn and Associates, Inc.  
 Philip Neal, PE

