



-----CAUTION-----
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

Nashville Canopy
 WSWE# 20-WL-0019
 Proposed Public Water
 Parcel # 09314056500
 District 19

-  - Proposed 8" Water Main (DIP)...205 LF
-  - Proposed Fire Hydrant Assemblies... 1 Unit
-  - Abandon Existing 6" Water Main, Line 116FB029...205 LF
-  - Abandon Section of 6" Water Main, Line 116FB029...9 LF

07/17/2020
 Ragan-Smith
 Michael Williams, P.E.

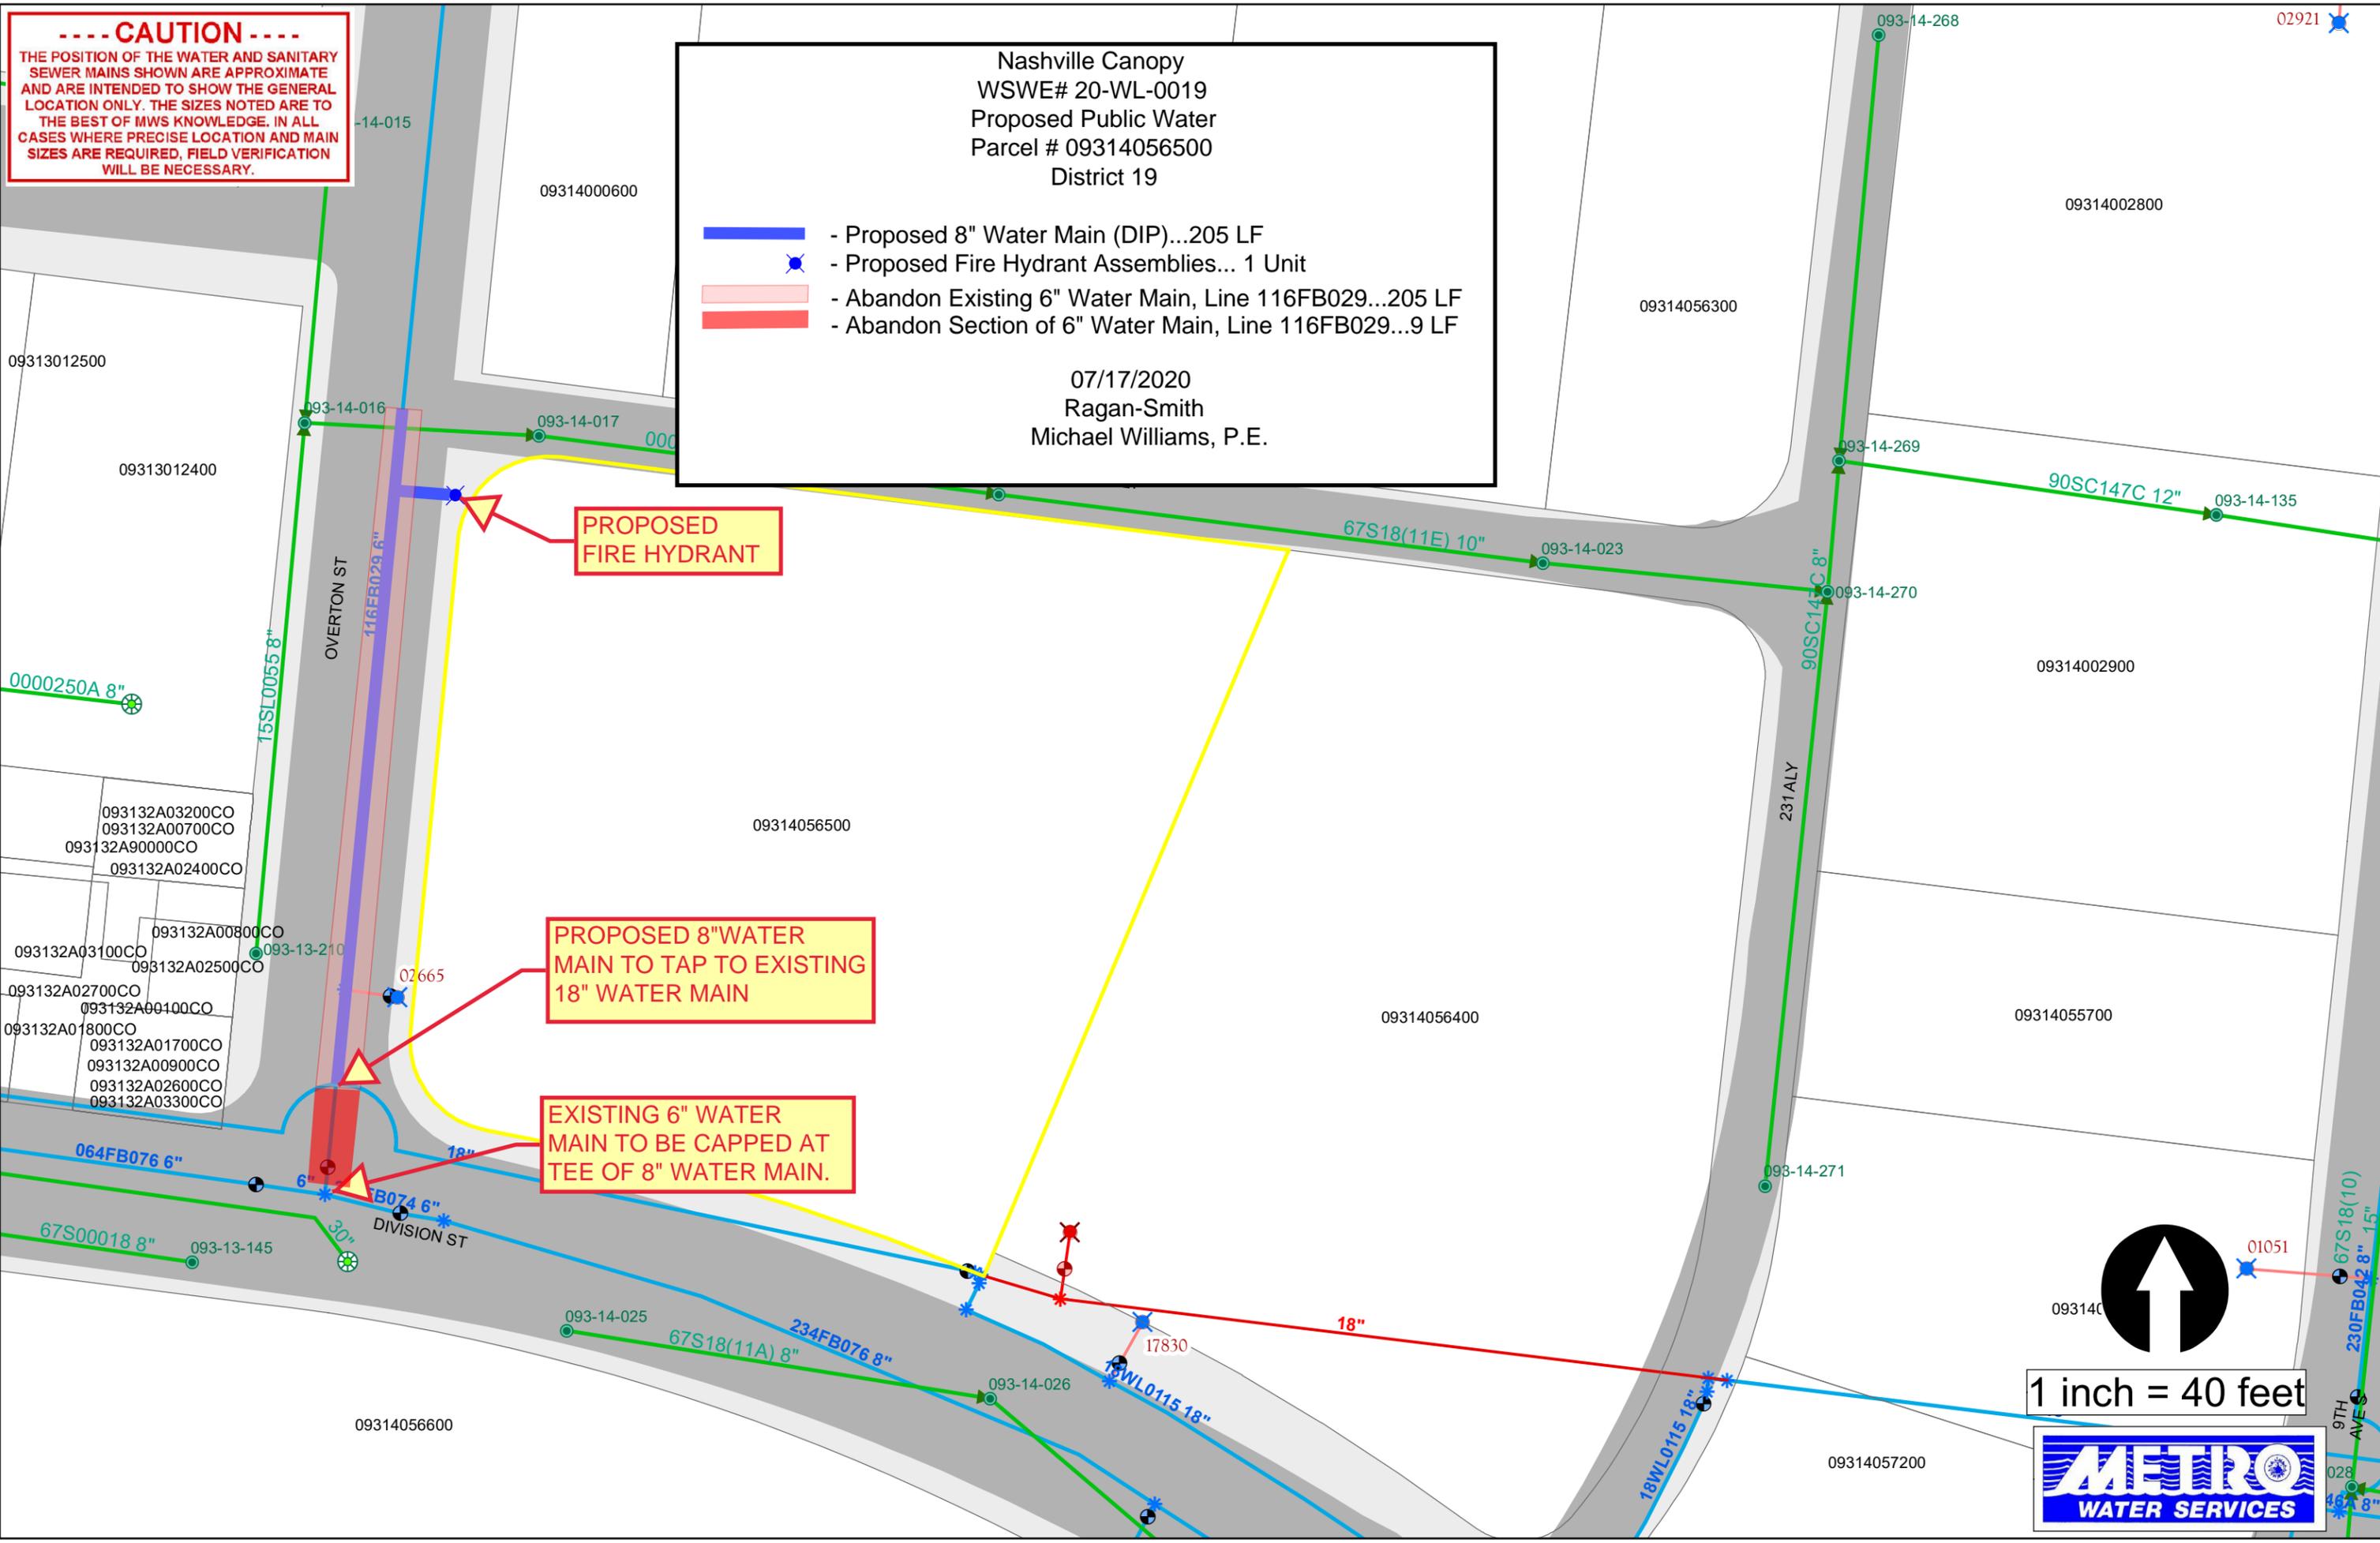

PROPOSED FIRE HYDRANT

PROPOSED 8" WATER MAIN TO TAP TO EXISTING 18" WATER MAIN

EXISTING 6" WATER MAIN TO BE CAPPED AT TEE OF 8" WATER MAIN.

1 inch = 40 feet

