

ORDINANCE NO. BL2020 - 500

An ordinance authorizing The Metropolitan Government of Nashville and Davidson County to accept new public water and sanitary sewer mains, fire hydrant assemblies, sanitary sewer manholes and easements, for two properties located on Old Hickory Boulevard at Legacy Drive, also known as Old Hickory Crossing Phase 2 (MWS Project Nos. 20-WL-106 and 20-SL-212 and Proposal No. 2020M-080ES-001).

WHEREAS, the acceptance of approximately 1,247 linear feet of new eight inch water main (DIP), approximately 242 linear feet of new six inch water main (DIP), approximately 1,032 linear feet of new eight inch sanitary sewer main (PVC), three fire hydrant assemblies, seven sanitary sewer manholes and easements, for properties located at Old Hickory Boulevard at Legacy Drive, also known as Old Hickory Crossing Phase 2, is needed to construct project numbers 20-WL-106 and 20-SL-212; and,

WHEREAS, the Metropolitan Planning Commission approved mandatory referral No. 2020M-080ES-001 on September 25, 2020, for the acceptance of said water and sanitary sewer mains, fire hydrant assemblies, sanitary sewer manholes and easements.

NOW, THEREFORE, BE IT ENACTED BY THE COUNCIL OF THE METROPOLITAN GOVERNMENT OF NASHVILLE AND DAVIDSON COUNTY:

Section 1. The Metropolitan Government of Nashville and Davidson County is authorized to accept approximately 1,247 linear feet of new eight inch water main (DIP), approximately 242 linear feet of new six inch water main (DIP), approximately 1,032 linear feet of new eight inch sanitary sewer main (PVC), three fire hydrant assemblies, seven sanitary sewer manholes and easements, for properties located at Old Hickory Boulevard at Legacy Drive, also known as Old Hickory Crossing Phase 2, as shown on Exhibit 1, which is attached hereto and incorporated by reference.

Map & Parcel:

Address:

18200001304

Old Hickory Boulevard (unnumbered)

18200001500

Old Hickory Boulevard (unnumbered)

Section 2. The Directors of Water and Sewerage Services and Public Property Administration are authorized to execute such documents as may be necessary and appropriate to carry out the acceptance authorized by this ordinance.

Section 3. Amendments to this legislation shall be approved by resolution.

Section 4. This ordinance shall take effect from and after its final passage, the welfare of The Metropolitan Government of Nashville and Davidson County requiring it.

RECOMMENDED BY:

INTRODUCED BY:

DocuSigned by:

Scott Potter

994E7D0AE02B458...

Scott A. Potter, Director
Water and Sewerage Services



DocuSigned by:

Trael Webb

D5CE33C0994645C...

Trael Webb, Director
Public Property Administration



Council Member(s)

APPROVED AS TO THE
AVAILABILITY OF FUNDS:

DocuSigned by:

Kevin Crumbo

9ACD297069E14E9...

Kevin Crumbo, Director
Department of Finance

APPROVED AS TO FORM
AND LEGALITY:

DocuSigned by:

Sara Ladd

E355FC378FE2427...

Assistant Metropolitan Attorney



**METROPOLITAN GOVERNMENT
OF NASHVILLE AND DAVIDSON COUNTY**

Planning Department
Metro Office Building
800 Second Avenue South
Nashville, Tennessee 37201

September 25, 2020

To: Mike Atchison, Metro Water Services

**Re: Old Hickory Crossings Phase 2
Planning Commission Mandatory Referral #2020M-080ES-001
Council District #31 - John Rutherford, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

A request for the acceptance of approximately 1,032 linear feet of 8-inch sanitary sewer main (PVC), seven sanitary sewer manholes, 1,247 linear feet of 8-inch water main (DIP), 242 linear feet of 6-inch water main (DIP), three fire hydrant assemblies, and easements (see sketch for details) to serve the Old Hickory Crossings Phase 2 development (see associated MWS proj. no. 20-SL-212 and 20-WL-106).

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

Conditions that apply to this approval: None.

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Sharon O’Conner at Sharon.oconner@nashville.gov or [615-862-7208](tel:615-862-7208).

Sincerely,


A handwritten signature in cursive script that reads "Robert Leeman".

Robert Leeman, AICP
Deputy Director
Metro Planning Department

cc: Metro Clerk, Elizabeth Waites

Re: Old Hickory Crossings Phase 2
Planning Commission Mandatory Referral #2020M-080ES-001
Council District #31 - John Rutherford, Council Member

A request for the acceptance of approximately 1,032 linear feet of 8-inch sanitary sewer main (PVC), seven sanitary sewer manholes, 1,247 linear feet of 8-inch water main (DIP), 242 linear feet of 6-inch water main (DIP), three fire hydrant assemblies, and easements (see sketch for details) to serve the Old Hickory Crossings Phase 2 development (see associated MWS proj. no. 20-SL-212 and 20-WL-106).

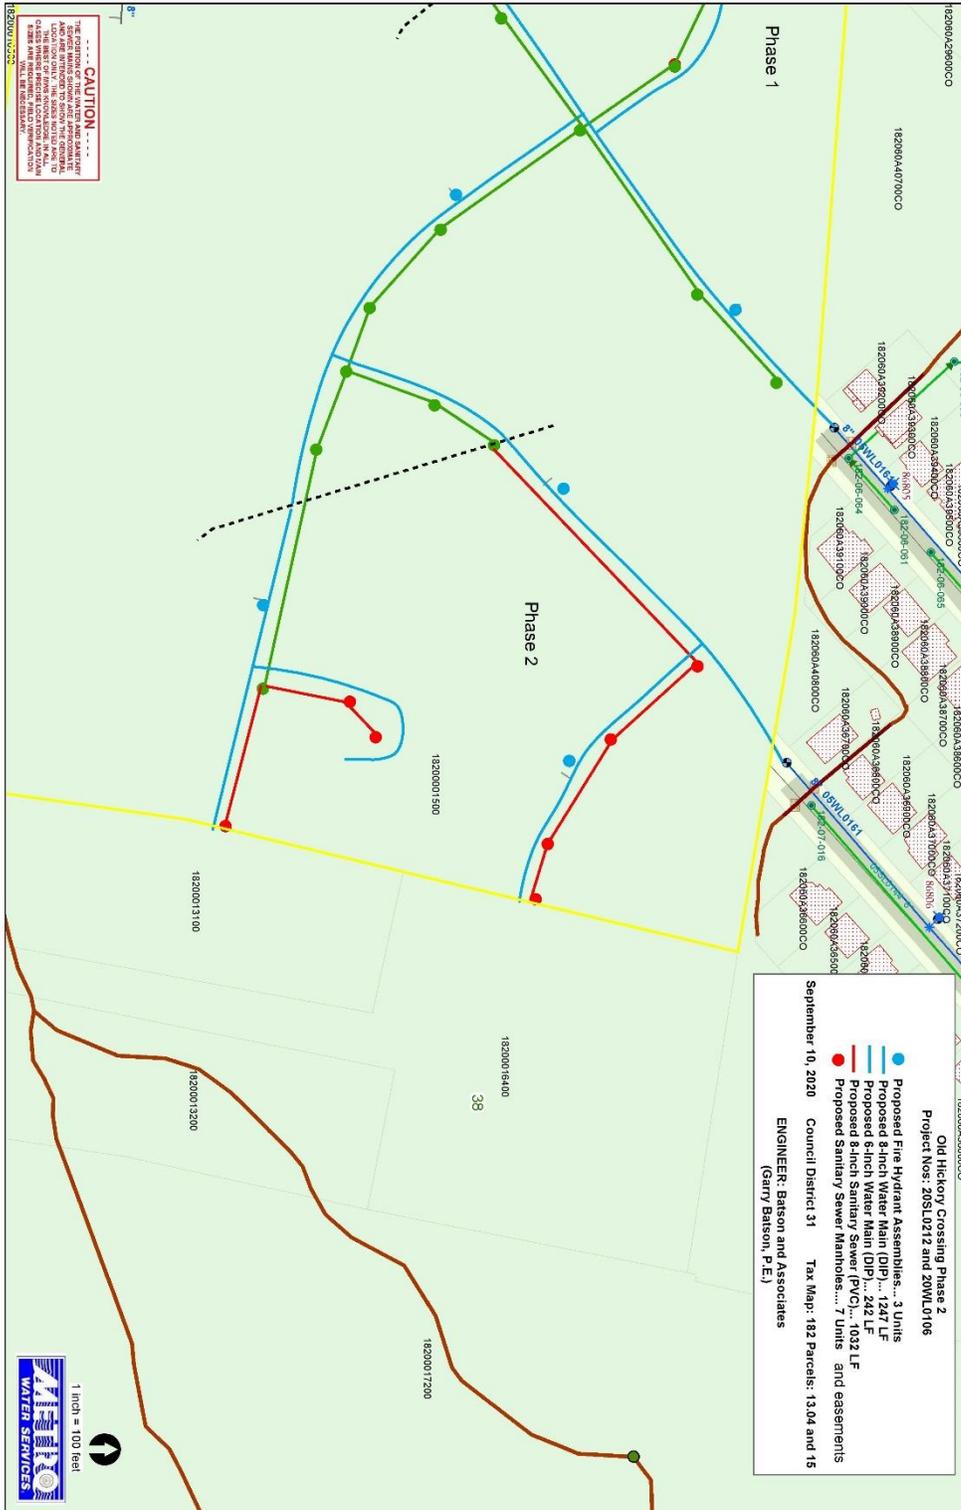

182060A29600CO

182060A40700CO

182060A39600CO
 182060A39500CO
 182060A39400CO
 182060A39300CO
 182060A39200CO
 182060A39100CO
 182060A39000CO
 182060A38900CO
 182060A38800CO
 182060A38700CO
 182060A38600CO
 182060A38500CO
 182060A38400CO
 182060A38300CO
 182060A38200CO
 182060A38100CO
 182060A38000CO
 182060A37900CO
 182060A37800CO
 182060A37700CO
 182060A37600CO
 182060A37500CO
 182060A37400CO
 182060A37300CO
 182060A37200CO
 182060A37100CO
 182060A37000CO
 182060A36900CO
 182060A36800CO
 182060A36700CO
 182060A36600CO
 182060A36500CO
 182060A36400CO
 182060A36300CO
 182060A36200CO
 182060A36100CO
 182060A36000CO

182060A36000CO

Old Hickory Crossing Phase 2
Project Nos: 20SL0212 and 20WL0106

- Proposed Fire Hydrant Assemblies... 3 Units
- Proposed 8-Inch Water Main (DIP)... 1247 LF
- Proposed 6-Inch Water Main (DIP)... 242 LF
- Proposed 8-Inch Sanitary Sewer (PVC)... 1032 LF
- Proposed Sanitary Sewer Manholes.... 7 Units and easements

September 10, 2020 Council District 31 Tax Map: 182 Parcels: 13.04 and 15

ENGINEER: Batson and Associates
 (Garry Batson, P.E.)

Phase 1

Phase 2

18200016400

38

18200001500

18200017200

18200013100

18200013200

8"

----- CAUTION -----
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.



1 inch = 100 feet



18200010500

ORIGINAL

METROPOLITAN COUNTY COUNCIL

Bill No. _____

An ordinance authorizing The Metropolitan Government of Nashville and Davidson County to accept new public water and sanitary sewer mains, fire hydrant assemblies, sanitary sewer manholes and easements, for two properties located on Old Hickory Boulevard at Legacy Drive, also known as Old Hickory Crossing Phase 2 (MWS Project Nos. 20-WL-106 and 20-SL-212 and Proposal No. 2020M-080ES-001).

Introduced _____

Passed First Reading _____

Amended _____

Passed Second Reading _____

Passed Third Reading _____

Approved _____

By _____

Metropolitan Mayor

Advertised _____

Effective Date _____
