

JOHN COOPER
MAYOR



METROPOLITAN GOVERNMENT OF NASHVILLE AND DAVIDSON COUNTY

DEPARTMENT OF WATER AND SEWERAGE SERVICES
Engineering Division
1600 Second Avenue North
Nashville, Tennessee 37208-2205

November 17, 2021

Michelle Hollingsworth
Metropolitan Planning Commission
720 2nd Ave. South
Nashville, TN 37210

Re: Gulf Union South Tower Development
1207 McGavock Street
MWS Project Nos.: 21-SL-135 and 21-WL-57
Abandonment of Sanitary Sewer Main, Sanitary Sewer Manholes, Fire Hydrant
Assembly and Easements
Acceptance of Sanitary Sewer Manhole, Fire Hydrant Assembly and Easements
Tax Map & Parcel 093090E00200CO
Requested by: Catalyst Design Group, Metro Water Services and Owner

Dear Ms. Hollingsworth;

Attached is a drawing for review showing the area that is aforementioned for the abandonment of approximately 204 linear feet of 10-inch sanitary sewer main, three sanitary sewer manholes, one fire hydrant assembly and easements, and the acceptance of one sanitary sewer manhole, one fire hydrant assembly, and easements to serve the Gulf Union South Tower development.

Please notify us of your approval in order that we may submit an Ordinance to the Metro Council.

Should you have any questions please call me at 862-4935.

Sincerely,

A handwritten signature in blue ink that reads "Mike Atchison".

Mike Atchison
Technical Specialist II




If you need assistance or an accommodation, please contact Metro Water Services,
at 615-862-4862, 1600 Second Avenue North, Nashville, Tennessee 37208.

Gulch Union South Tower Project Nos.: 21SL0135 and 21WL0057

- ~ Abandoned Sanitary Sewer (10") ... 204 LF
- ~ Abandoned Sanitary Manhole 3 Units
- ~ Abandoned Fire Hydrant 1 Unit
- Proposed Sanitary Manhole 1 Unit
- Proposed Fire Hydrant 1 Unit (and easements)

November 16, 2021 Council District 19 APN: 093090E00200CO

Engineer: Catalyst Design Group
(Andrew Wiseman, P.E.)

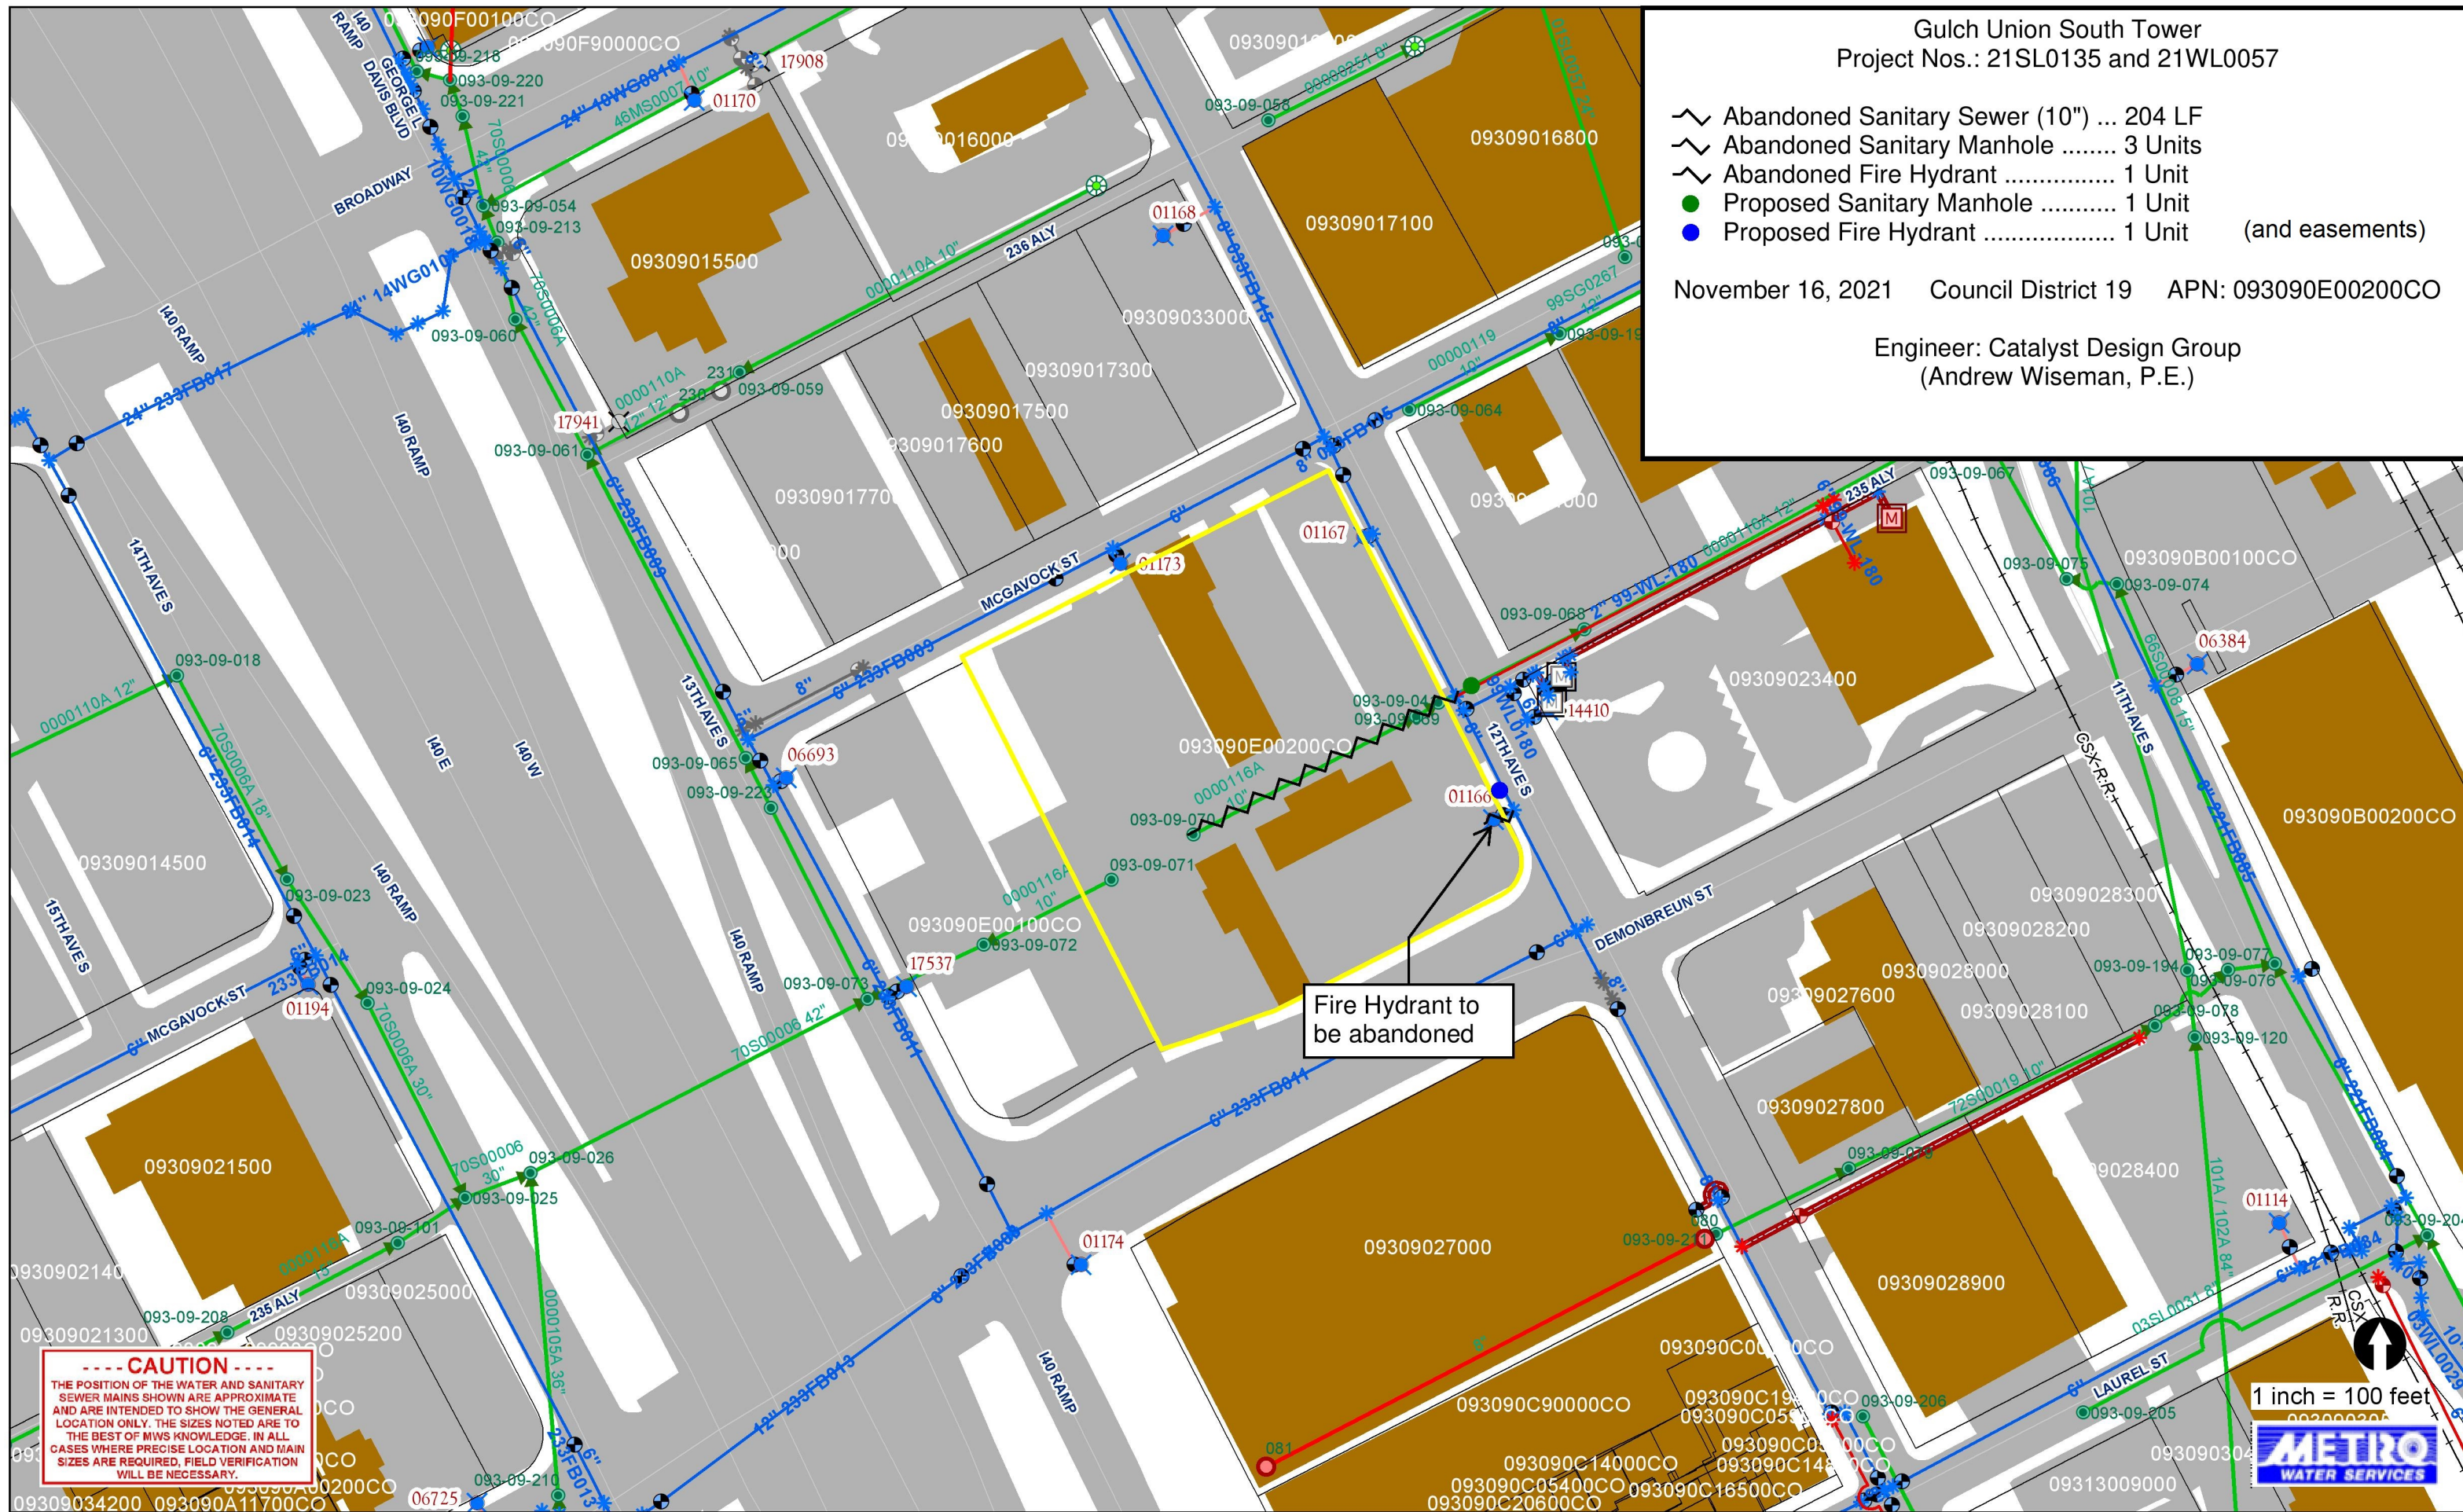

----- CAUTION -----
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

Fire Hydrant to be abandoned

1 inch = 100 feet

