



**METROPOLITAN GOVERNMENT OF NASHVILLE
AND DAVIDSON COUNTY**

Metro Office Building
800 President Ronald Reagan Way
P.O. Box 196300
Nashville, TN 37219-6300

March 10, 2023

To: Edward Thurman Metro Water Services

**Re: VANDERBILT UNIVERSITY BASKETBALL FACILITY
Planning Commission Mandatory Referral # 2023M-035ES-001
Council District #18 Tom Cash, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

A request for the abandonment of approximately 262 linear feet of 6-inch water main (DIP), 326 linear feet of 16-inch water main (DIP) and one fire hydrant assembly and the acceptance of approximately 296 linear feet of 16-inch water main (DIP) to serve the Vanderbilt University Basketball Facility development.

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

Conditions that apply to this approval: Fire hydrant locations shall maintain maximum 100' from fire department standpipe connections (FDC).

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at delilah.rhodes@nashville.gov or 615-862-7208.


Sincerely,

A handwritten signature in blue ink, appearing to read "Lisa Milligan".

Lisa Milligan
Land Development Manager
Metro Planning Department
cc: Metro Clerk

**Re: VANDERBILT UNIVERSITY BASKETBALL FACILITY
Planning Commission Mandatory Referral # 2023M-035ES-001
Council District #18 Tom Cash, Council Member**

A request for the abandonment of approximately 262 linear feet of 6-inch water main (DIP), 326 linear feet of 16-inch water main (DIP) and one fire hydrant assembly and the acceptance of approximately 296 linear feet of 16-inch water main (DIP) to serve the Vanderbilt University Basketball Facility development.

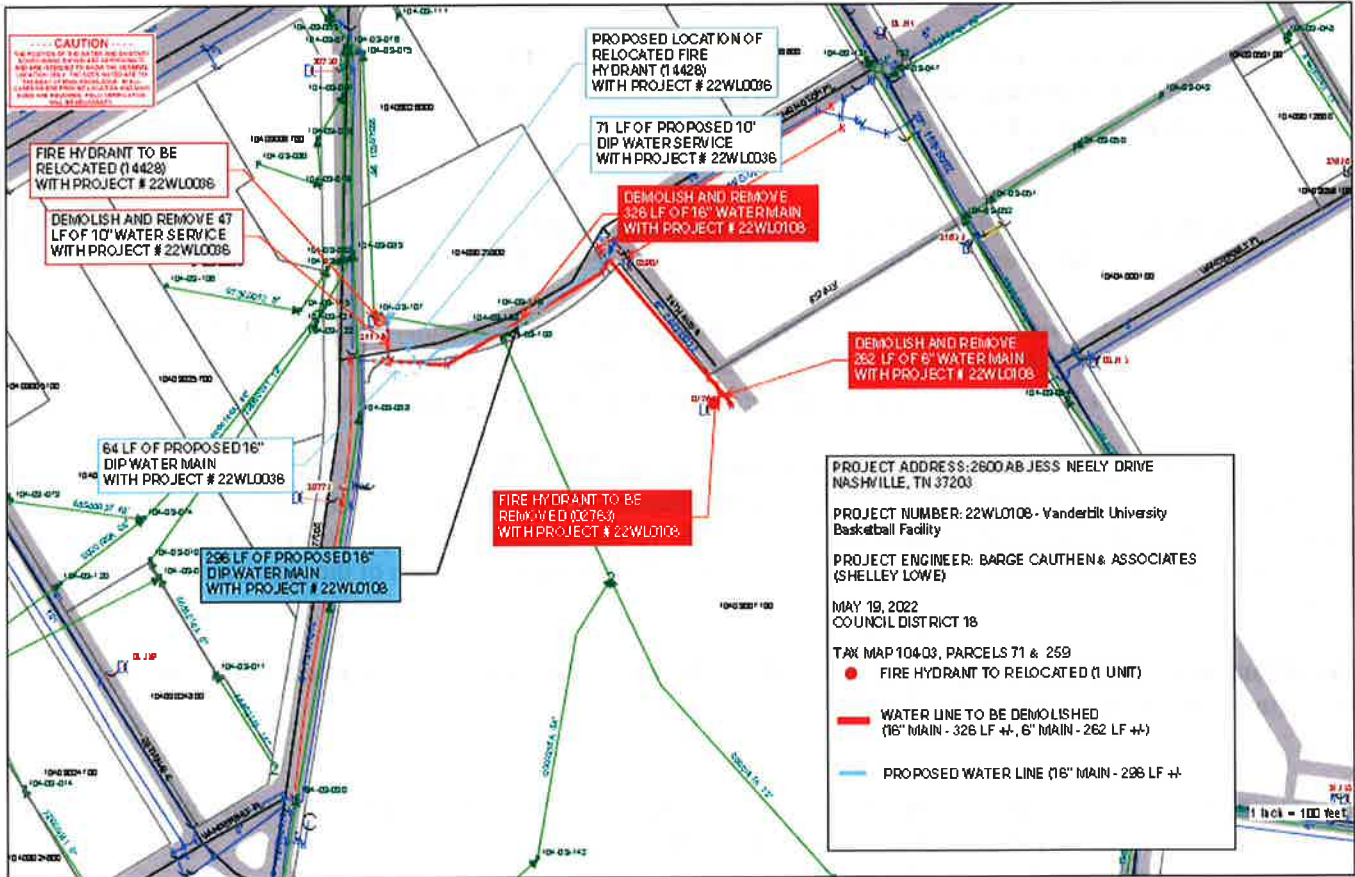

----- CAUTION -----
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

FIRE HYDRANT TO BE RELOCATED (14428) WITH PROJECT # 22WL0036

DEMOLISH AND REMOVE 47 LF OF 10" WATER SERVICE WITH PROJECT # 22WL0036

64 LF OF PROPOSED 16" DIP WATER MAIN WITH PROJECT # 22WL0036

296 LF OF PROPOSED 16" DIP WATER MAIN WITH PROJECT # 22WL0108

PROPOSED LOCATION OF RELOCATED FIRE HYDRANT (14428) WITH PROJECT # 22WL0036

71 LF OF PROPOSED 10" DIP WATER SERVICE WITH PROJECT # 22WL0036

DEMOLISH AND REMOVE 326 LF OF 16" WATER MAIN WITH PROJECT # 22WL0108

FIRE HYDRANT TO BE REMOVED (02763) WITH PROJECT # 22WL0108

DEMOLISH AND REMOVE 262 LF OF 6" WATER MAIN WITH PROJECT # 22WL0108

PROJECT ADDRESS: 2600 AB JESS NEELY DRIVE
NASHVILLE, TN 37203

PROJECT NUMBER: 22WL0108 - Vanderbilt University Basketball Facility

PROJECT ENGINEER: BARGE CAUTHEN & ASSOCIATES (SHELLEY LOWE)

MAY 19, 2022
COUNCIL DISTRICT 18

TAX MAP 104-03, PARCELS 71 & 259

- FIRE HYDRANT TO RELOCATED (1 UNIT)
- WATER LINE TO BE DEMOLISHED (16" MAIN - 326 LF +/-, 6" MAIN - 262 LF +/-)
- PROPOSED WATER LINE (16" MAIN - 296 LF +/-)

1 inch = 100 feet

