


1 inch = 100 feet



LEGEND

EX	Existing
PR	Proposed
MH	Manhole
FH	Fire Hydrant
BO	Blow-Off

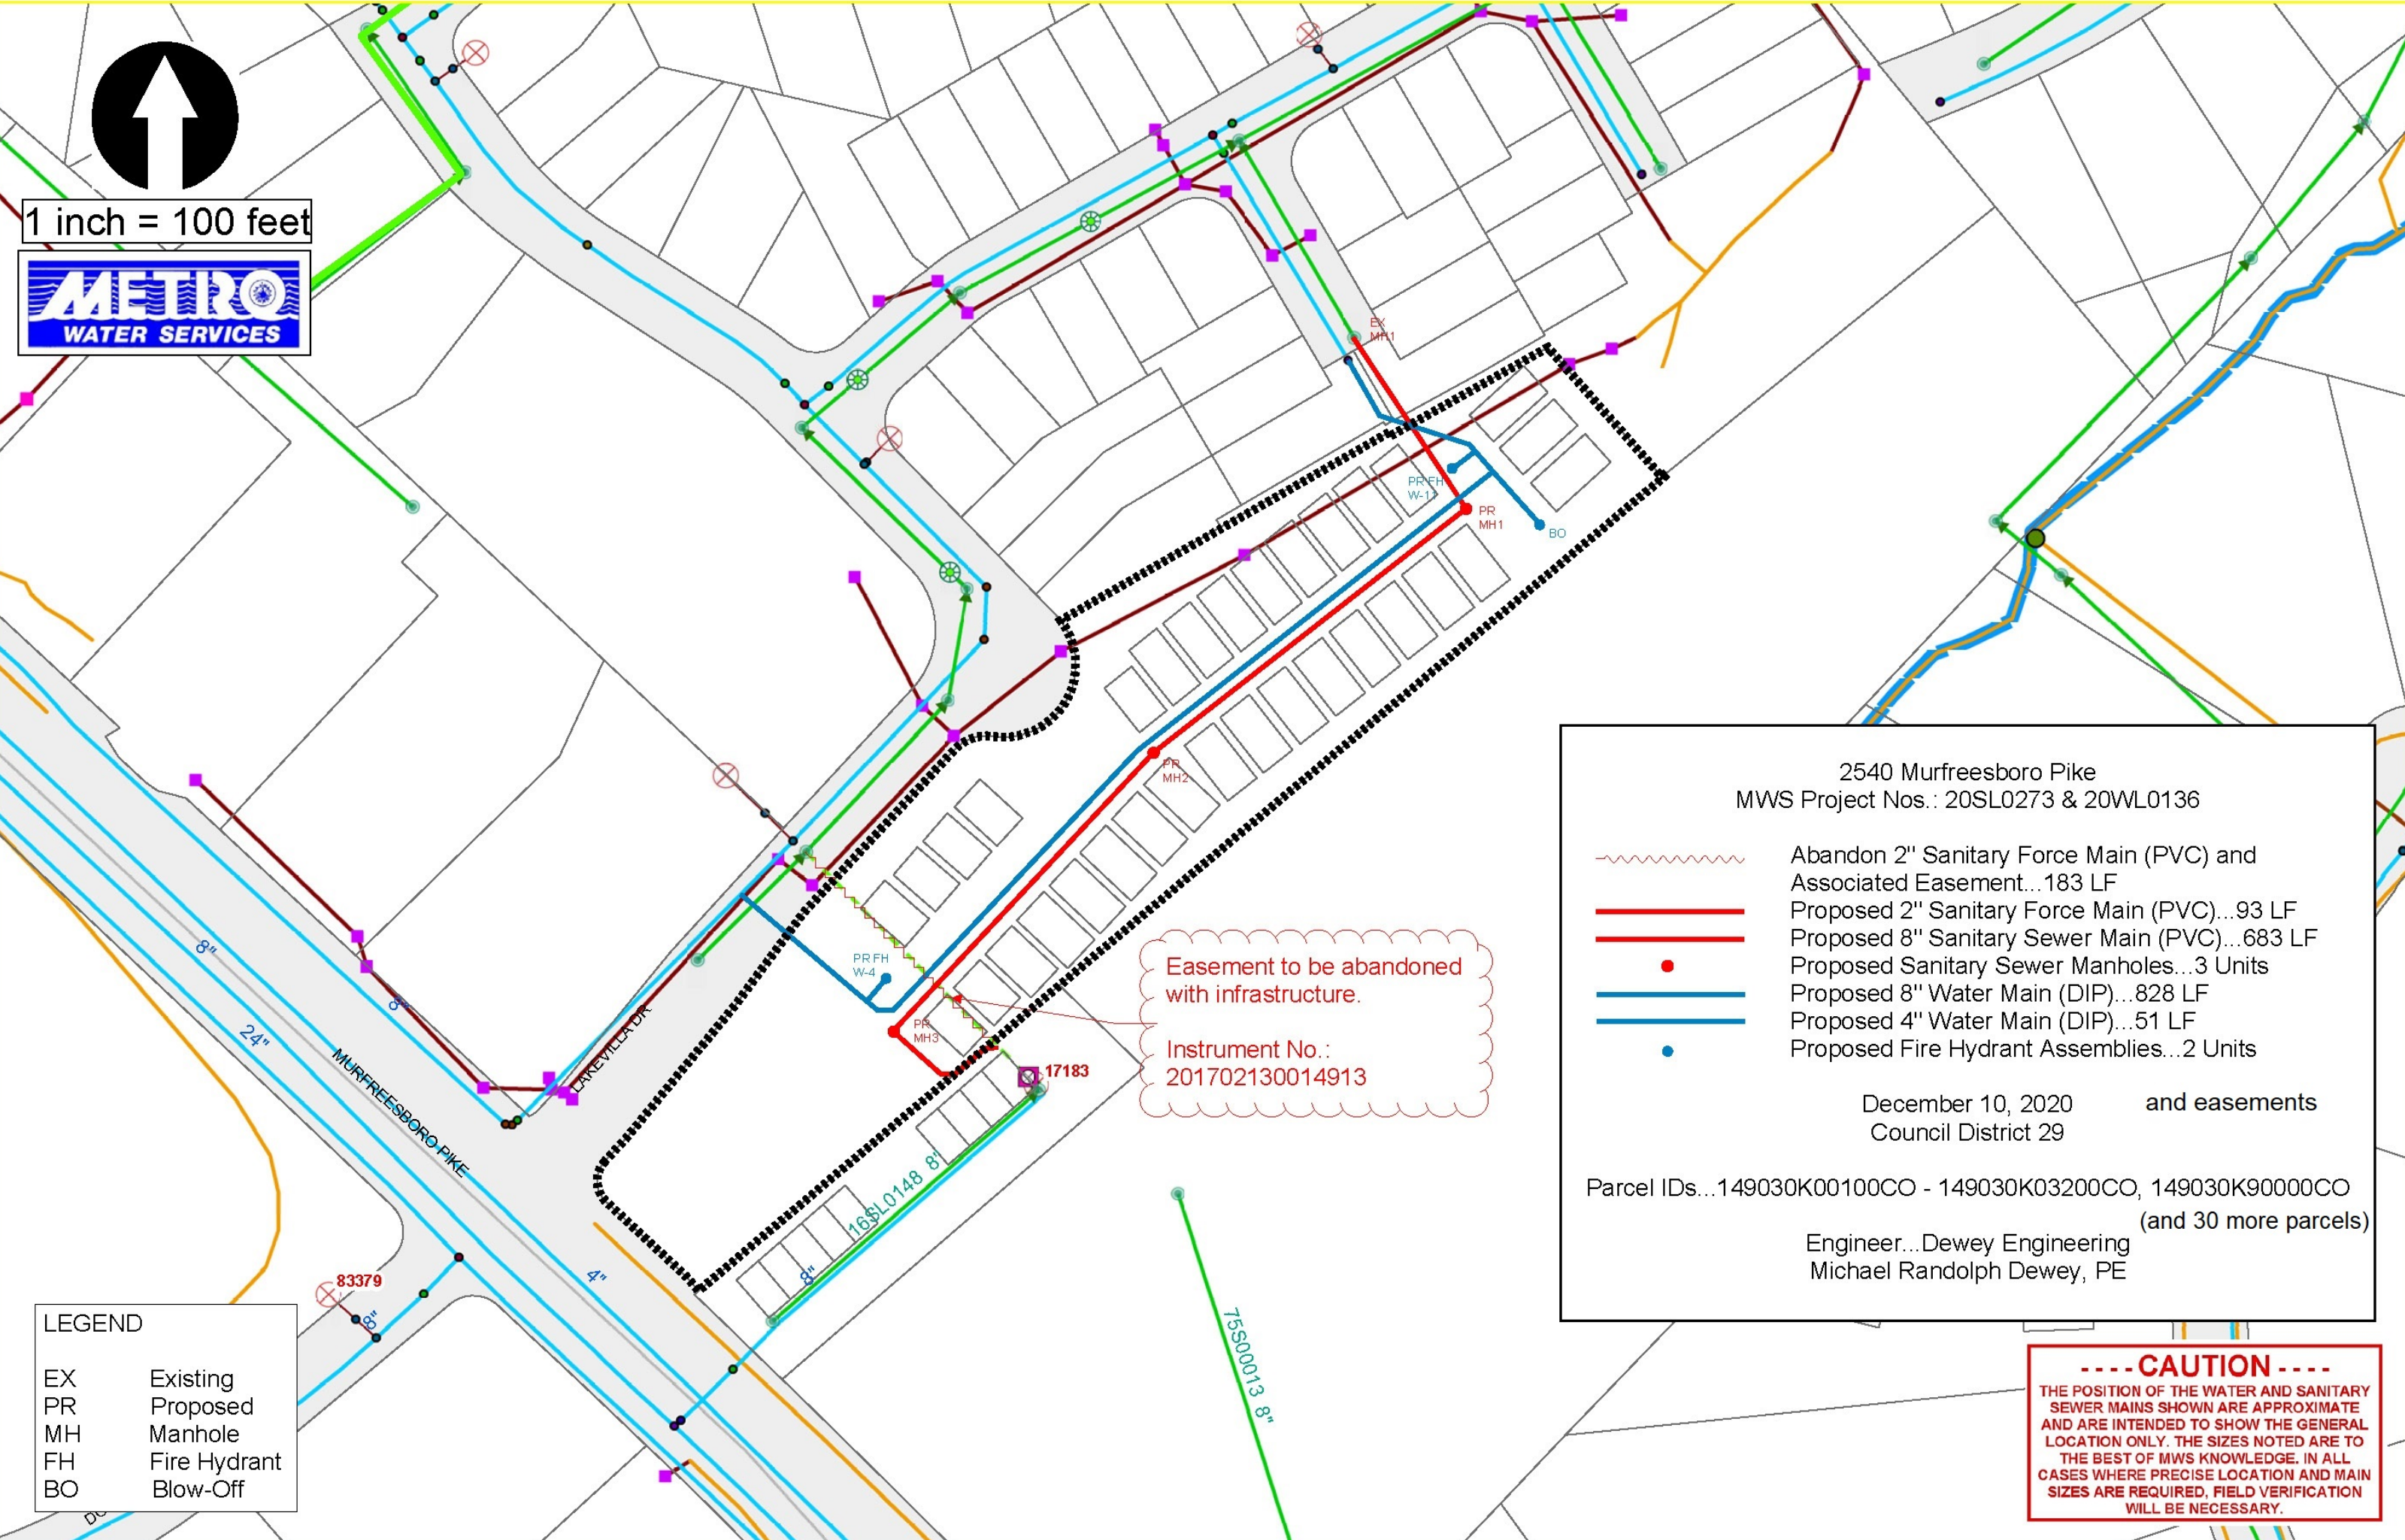

Easement to be abandoned with infrastructure.
Instrument No.: 201702130014913

2540 Murfreesboro Pike
MWS Project Nos.: 20SL0273 & 20WL0136

- Abandon 2" Sanitary Force Main (PVC) and Associated Easement...183 LF
- Proposed 2" Sanitary Force Main (PVC)...93 LF
- Proposed 8" Sanitary Sewer Main (PVC)...683 LF
- Proposed Sanitary Sewer Manholes...3 Units
- Proposed 8" Water Main (DIP)...828 LF
- Proposed 4" Water Main (DIP)...51 LF
- Proposed Fire Hydrant Assemblies...2 Units

December 10, 2020 and easements
Council District 29

Parcel IDs...149030K00100CO - 149030K03200CO, 149030K90000CO (and 30 more parcels)

Engineer...Dewey Engineering
Michael Randolph Dewey, PE

-----CAUTION-----
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.