



February 20, 2024

To: Stephanie James Metro Water Services

**Re: Vanderbilt Garland Hall  
Planning Commission Mandatory Referral 2024M-032ES-001  
Council District #18 Tom Cash, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

*A request for the acceptance of approximately nine linear feet of six-inch water main (DIP) and one fire hydrant assembly to serve the Vanderbilt Garland Hall development.*

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

**Conditions that apply to this approval: none**

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at [Delilah.Rhodes@nashville.gov](mailto:Delilah.Rhodes@nashville.gov) or 615-862-7208


Sincerely,

A handwritten signature in black ink that reads "Lisa Milligan". The signature is written in a cursive, flowing style.

Lisa Milligan  
Assistant Director Land Development  
Metro Planning Department  
cc: *Metro Clerk*

**Re: Vanderbilt Garland Hall  
Planning Commission Mandatory Referral 2024M-032ES-001  
Council District #18 Tom Cash, Council Member**

*A request for the acceptance of approximately nine linear feet of six-inch water main (DIP) and one fire hydrant assembly to serve the Vanderbilt Garland Hall development.*

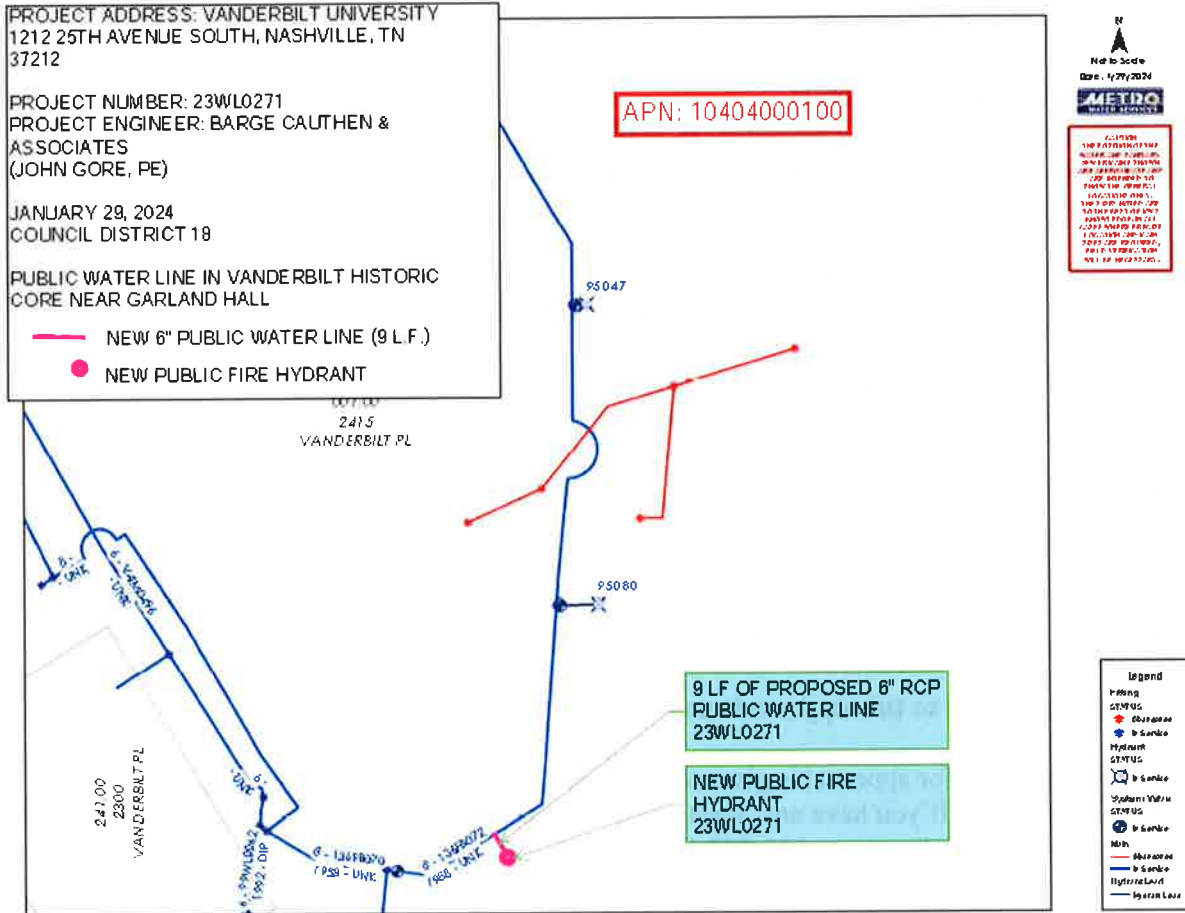

PROJECT ADDRESS: VANDERBILT UNIVERSITY  
1212 25TH AVENUE SOUTH, NASHVILLE, TN  
37212


PROJECT NUMBER: 23WL0271  
PROJECT ENGINEER: BARGE CAUTHEN &  
ASSOCIATES  
(JOHN GORE, PE)

JANUARY 29, 2024  
COUNCIL DISTRICT 18

PUBLIC WATER LINE IN VANDERBILT HISTORIC  
CORE NEAR GARLAND HALL

- NEW 6" PUBLIC WATER LINE (9 L.F.)
- NEW PUBLIC FIRE HYDRANT

APN: 10404000100

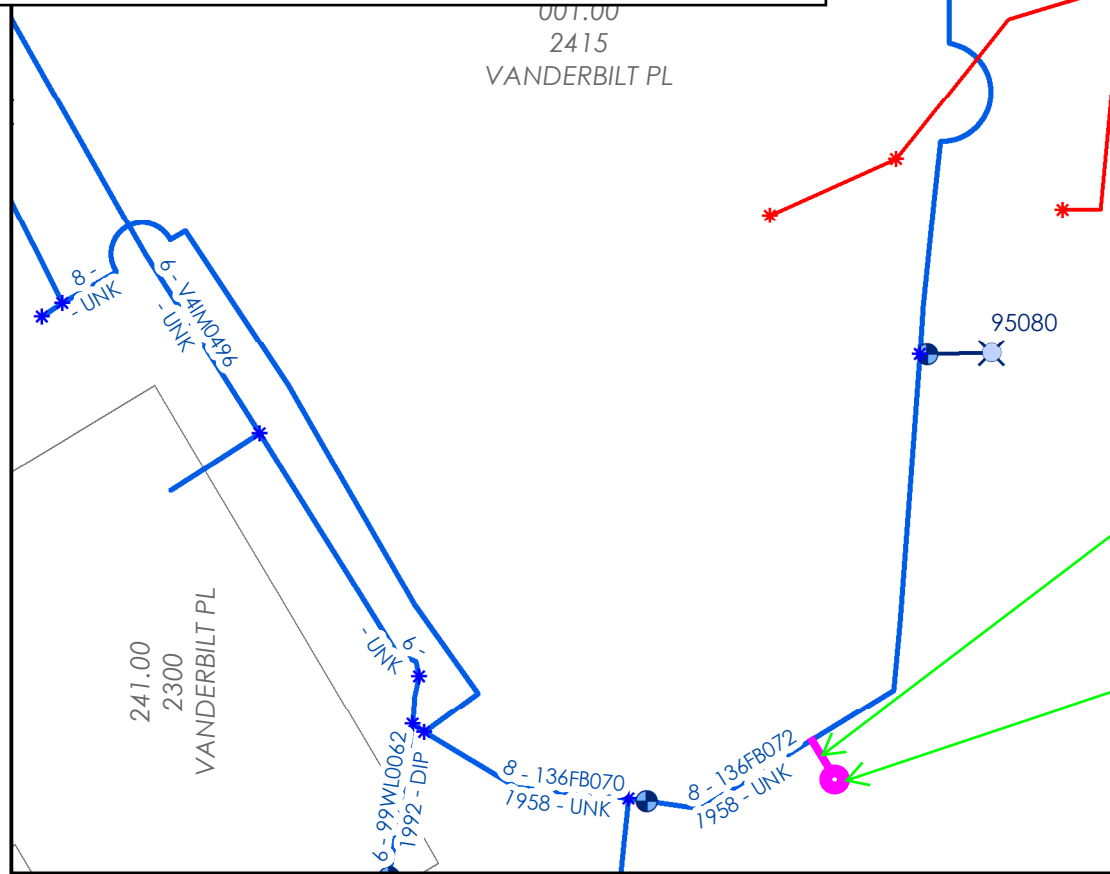

9 LF OF PROPOSED 6" RCP  
PUBLIC WATER LINE  
23WL0271

NEW PUBLIC FIRE  
HYDRANT  
23WL0271

N  
Not to Scale  
Date: 1/29/2024



--- CAUTION ---  
THE POSITION OF THE  
WATER AND SANITARY  
SEWER MAINS SHOWN  
ARE APPROXIMATE AND  
ARE INTENDED TO  
SHOW THE GENERAL  
LOCATIONS ONLY.  
THE SIZES NOTED ARE  
TO THE BEST OF MWS  
KNOWLEDGE. IN ALL  
CASES WHERE PRECISE  
LOCATION AND MAIN  
SIZES ARE REQUIRED,  
FIELD VERIFICATION  
WILL BE NECESSARY.

Legend	
<b>Fitting</b>	
<b>STATUS</b>	
<span style="color: red;">*</span>	Abandoned
<span style="color: blue;">*</span>	In Service
<b>Hydrant</b>	
<b>STATUS</b>	
	In Service
<b>System Valve</b>	
<b>STATUS</b>	
	In Service
<b>Main</b>	
<span style="color: red;">—</span>	Abandoned
<span style="color: blue;">—</span>	In Service
<b>Hydrant Lead</b>	
<span style="color: blue;">—</span>	Hydrant Lead