



**METROPOLITAN GOVERNMENT
OF NASHVILLE AND DAVIDSON COUNTY**

Planning Department
Metro Office Building
800 Second Avenue South
Nashville, Tennessee 37201

July 29, 2022

To: Edward Thurman, Public Metro Water

**Re: DONELSON LIBRARY DEVELOPMENT
Planning Commission Mandatory Referral #2022M-109ES-001
Council District #15 Jeff Syracuse, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

A request for approval for the abandonment of approximately 363 linear feet of 8-inch sanitary sewer main (PVC) and easements, and the acceptance of approximately 70 linear feet of 8-inch sanitary sewer main (PVC), three sanitary sewer manholes, one fire hydrant assembly and easements to serve the Donelson Library development.

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

Conditions that apply to this approval: none

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at delilah.rhodes@nashville.gov or 615-862-7208.


Sincerely,


A handwritten signature in blue ink, appearing to read "Lisa Milligan".

Lisa Milligan
Land Development Manager
Metro Planning Department
cc: *Metro Clerk*

Re: DONELSON LIBRARY DEVELOPMENT
Planning Commission Mandatory Referral #2022M-109ES-001
Council District #15 Jeff Syracuse, Council Member

A request for approval for the abandonment of approximately 363 linear feet of 8-inch sanitary sewer main (PVC) and easements, and the acceptance of approximately 70 linear feet of 8-inch sanitary sewer main (PVC), three sanitary sewer manholes, one fire hydrant assembly and easements to serve the Donelson Library development.

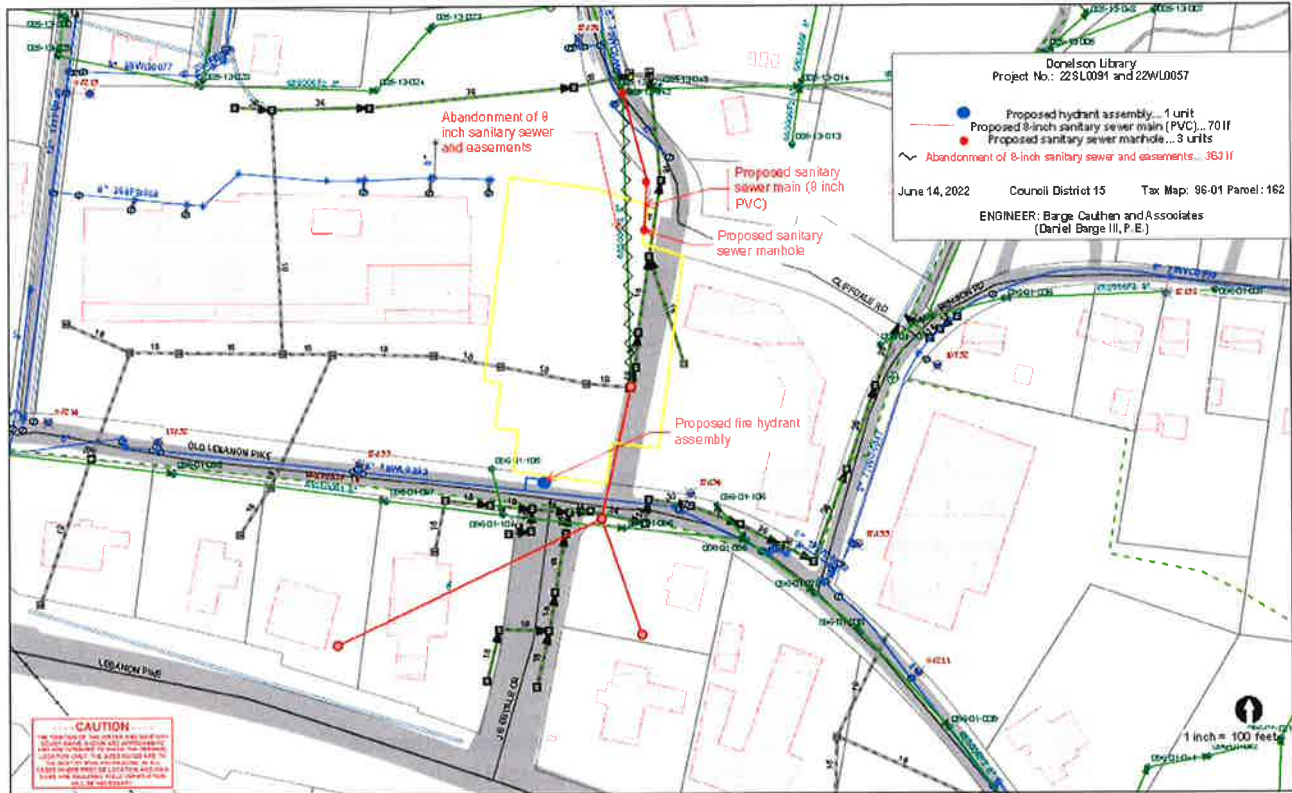

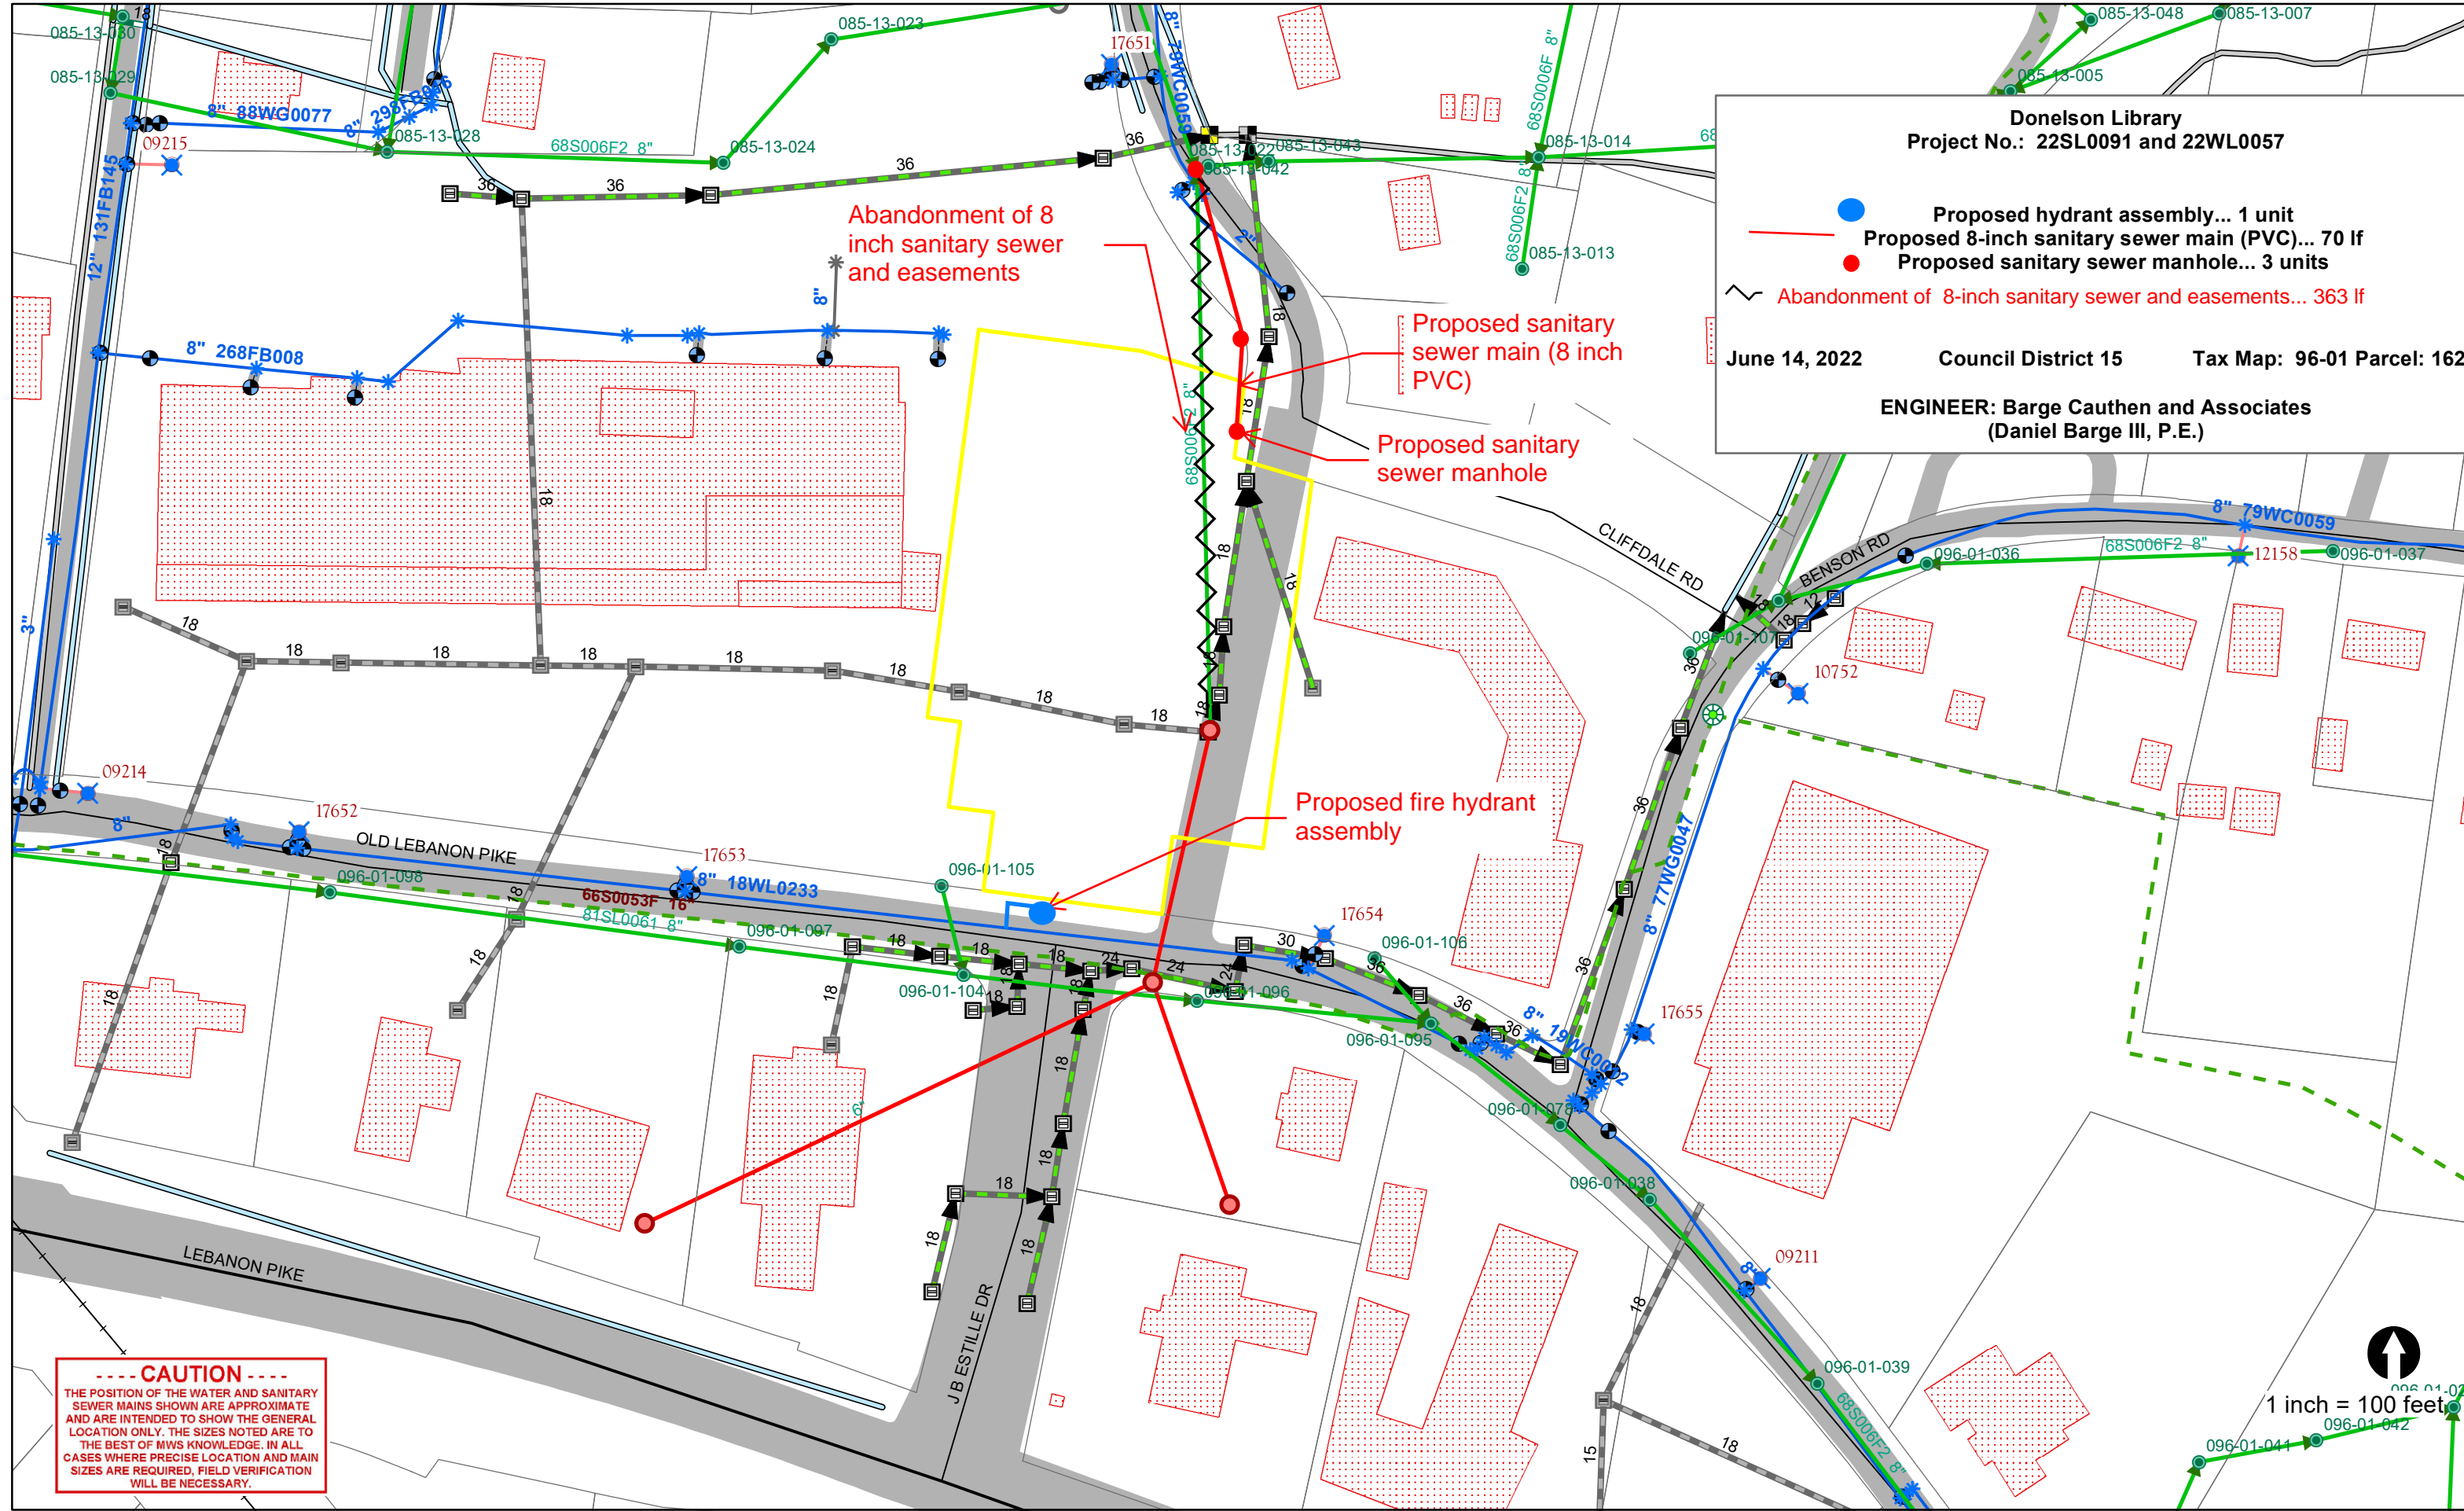

Donelson Library
Project No.: 22SL0091 and 22WL0057

- Proposed hydrant assembly... 1 unit
- Proposed 8-inch sanitary sewer main (PVC)... 70 lf
- Proposed sanitary sewer manhole... 3 units
- - - Abandonment of 8-inch sanitary sewer and easements... 363 lf

June 14, 2022 Council District 15 Tax Map: 96-01 Parcel: 162

ENGINEER: Barge Cauthen and Associates
 (Daniel Barge III, P.E.)

----- CAUTION -----
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

1 inch = 100 feet