



**METROPOLITAN GOVERNMENT OF NASHVILLE  
AND DAVIDSON COUNTY**  
Metro Office Building  
800 President Ronald Reagan Way  
P.O. Box 196300  
Nashville, TN 37219-6300

September 26, 2022

To: Mike Atchison, Metro Water Services

**Re: 3220 CHARLOTTE AVENUE  
Planning Commission Mandatory Referral #2022M-129ES-001  
Council District #21 Brandon Taylor, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

*A request for the relocation of one fire hydrant assembly to serve the development at 3220 Charlotte Ave.*

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

**Conditions that apply to this approval: none**

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at [delilah.rhodes@nashville.gov](mailto:delilah.rhodes@nashville.gov) or 615-862-7208.


Sincerely,

A handwritten signature in blue ink that reads "Lisa Milligan".

Lisa Milligan  
Land Development Manager  
Metro Planning Department  
cc: *Metro Clerk*


**Re: 3220 CHARLOTTE AVENUE**  
**Planning Commission Mandatory Referral #2022M-129ES-001**  
**Council District #21 Brandon Taylor, Council Member**

*A request for the relocation of one fire hydrant assembly to serve the development at 3220 Charlotte Ave.*

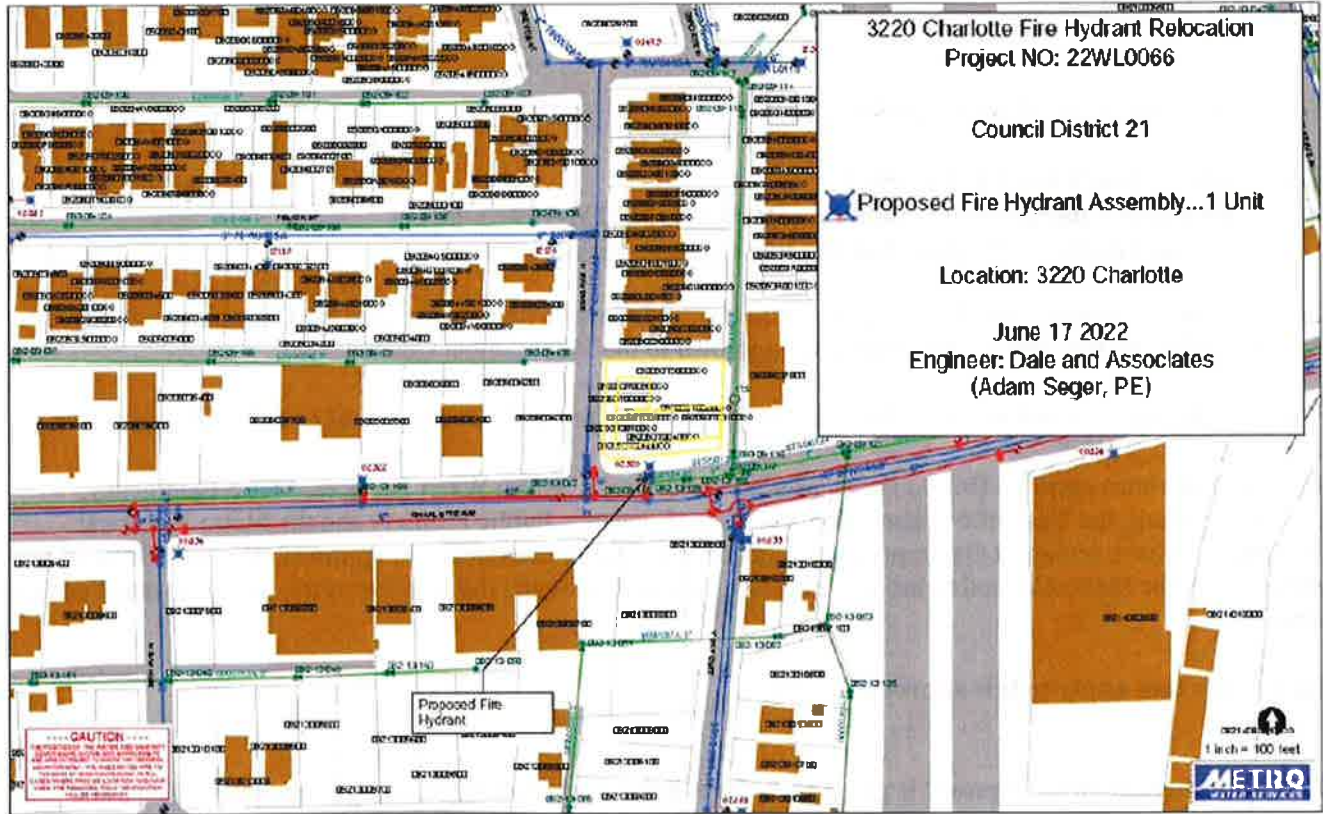

# 3220 Charlotte Fire Hydrant Relocation Project NO: 22WL0066


Council District 21

 Proposed Fire Hydrant Assembly...1 Unit

Location: 3220 Charlotte

June 17 2022

Engineer: Dale and Associates  
(Adam Seger, PE)

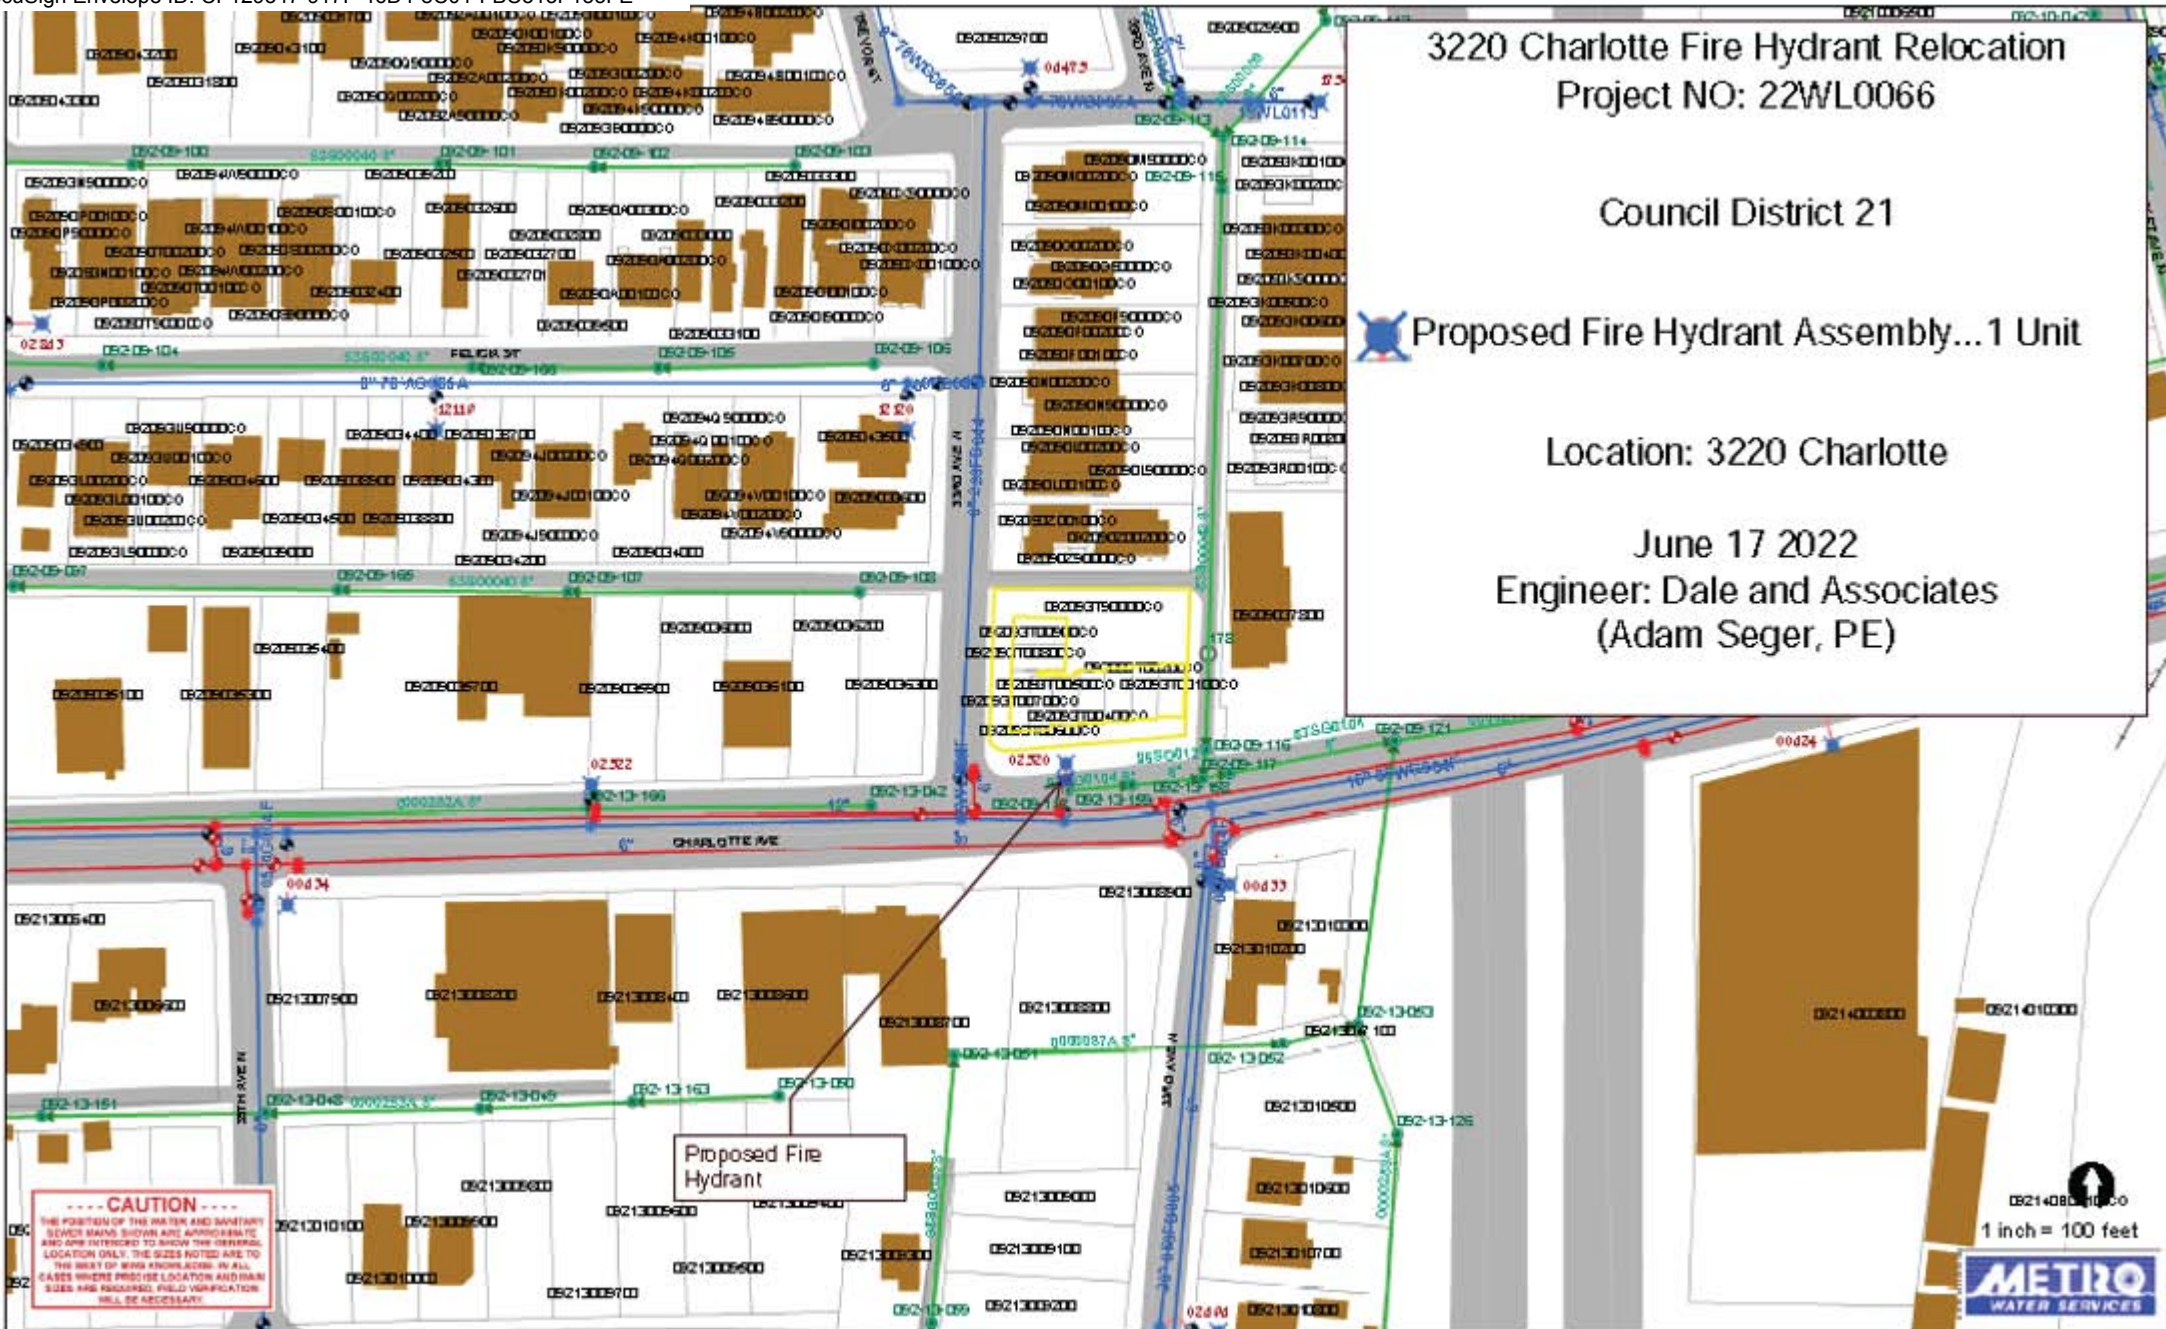

**CAUTION**

THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF OUR KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND DIM SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

Proposed Fire Hydrant

1 inch = 100 feet

**METRO**  
WATER SERVICES