



November 8, 2023

To: Mike Atchison Metro Water Services

**Re: THE MOSAIC AT JEFFERSON
Planning Commission Mandatory Referral 2023M-174ES-001
Council District #19 Jacob Kupin, Council Member**

On behalf of the Metropolitan Planning Commission, the following item, referred to the Commission as required by the Metro Charter, has been recommended for *approval* to the Metropolitan Council:

A request for the abandonment of approximately 740 linear feet of 6-inch water main (UNK) and the acceptance of approximately 740 linear feet of 8-inch water main (DIP) and one fire hydrant assembly to serve The Mosaic at Jefferson development.

The relevant Metro agencies (Metro Parks, Metro Public Works, Metro Water Services, Metro Emergency Communications, the Nashville Electric Service, Metro Finance – Public Property and the Metro Historical Commission) have reviewed the proposal and concur in the recommendation for approval. This request must be approved by the Metro Council to become effective. A sketch showing the location of the request is attached to this letter.

Conditions that apply to this approval: none

This recommendation for approval is given as set forth in the Metropolitan Planning Commission Rules and Procedures. If you have any questions about this matter, please contact Delilah Rhodes at Delilah.Rhodes@nashville.gov or 615-862-7208.


Sincerely,

A handwritten signature in blue ink that reads "Lisa Milligan". The signature is fluid and cursive.

Lisa Milligan
Assistant Director Land Development
Metro Planning Department
cc: *Metro Clerk*

Re: THE MOSAIC AT JEFFERSON
Planning Commission Mandatory Referral 2023M-174ES-001
Council District #19 Jacob Kupin, Council Member

A request for the abandonment of approximately 740 linear feet of 6-inch water main (UNK) and the acceptance of approximately 740 linear feet of 8-inch water main (DIP) and one fire hydrant assembly to serve The Mosaic at Jefferson development.

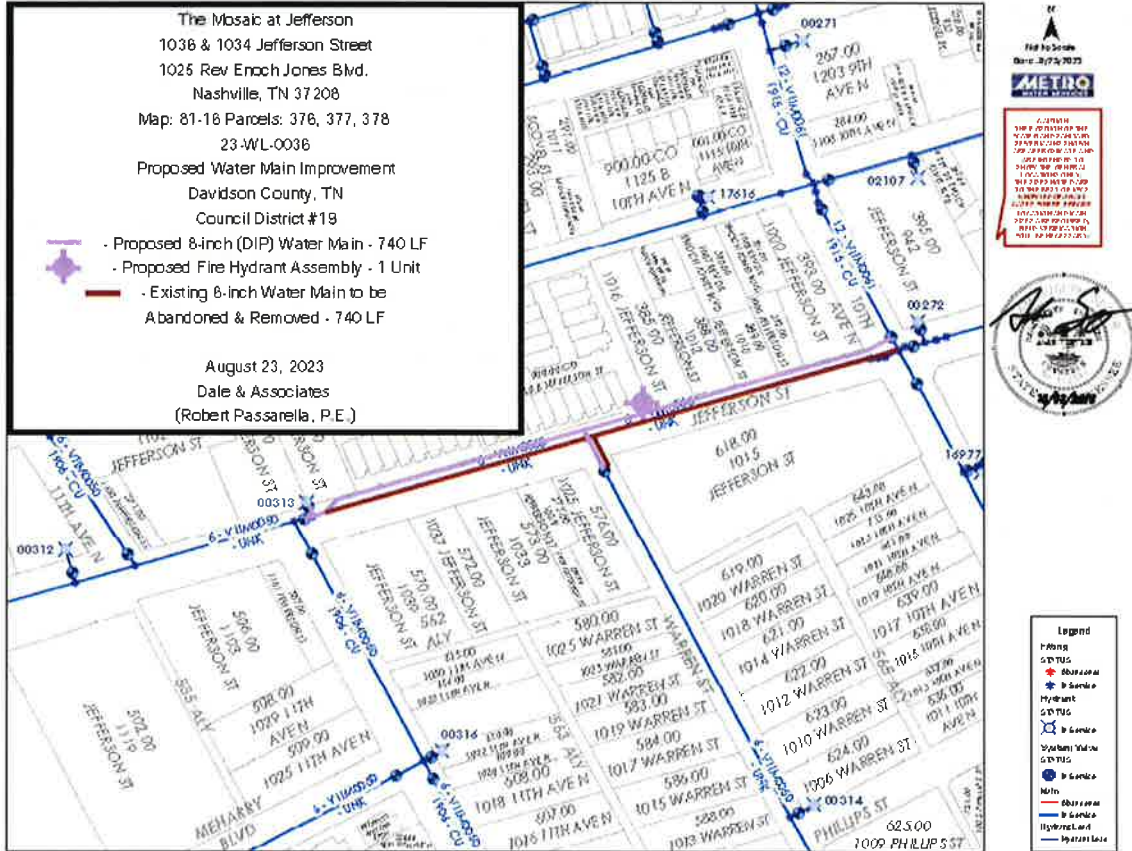


The Mosaic at Jefferson
1036 & 1034 Jefferson Street
1025 Rev Enoch Jones Blvd.
Nashville, TN 37208

Map: 81-16 Parcels: 376, 377, 378
23-WL-0036

Proposed Water Main Improvement
Davidson County, TN
Council District #19

- Proposed 8-inch (DIP) Water Main - 740 LF
- Proposed Fire Hydrant Assembly - 1 Unit
- Existing 6-inch Water Main to be Abandoned & Removed - 740 LF

August 23, 2023
Dale & Associates
(Robert Passarella, P.E.)

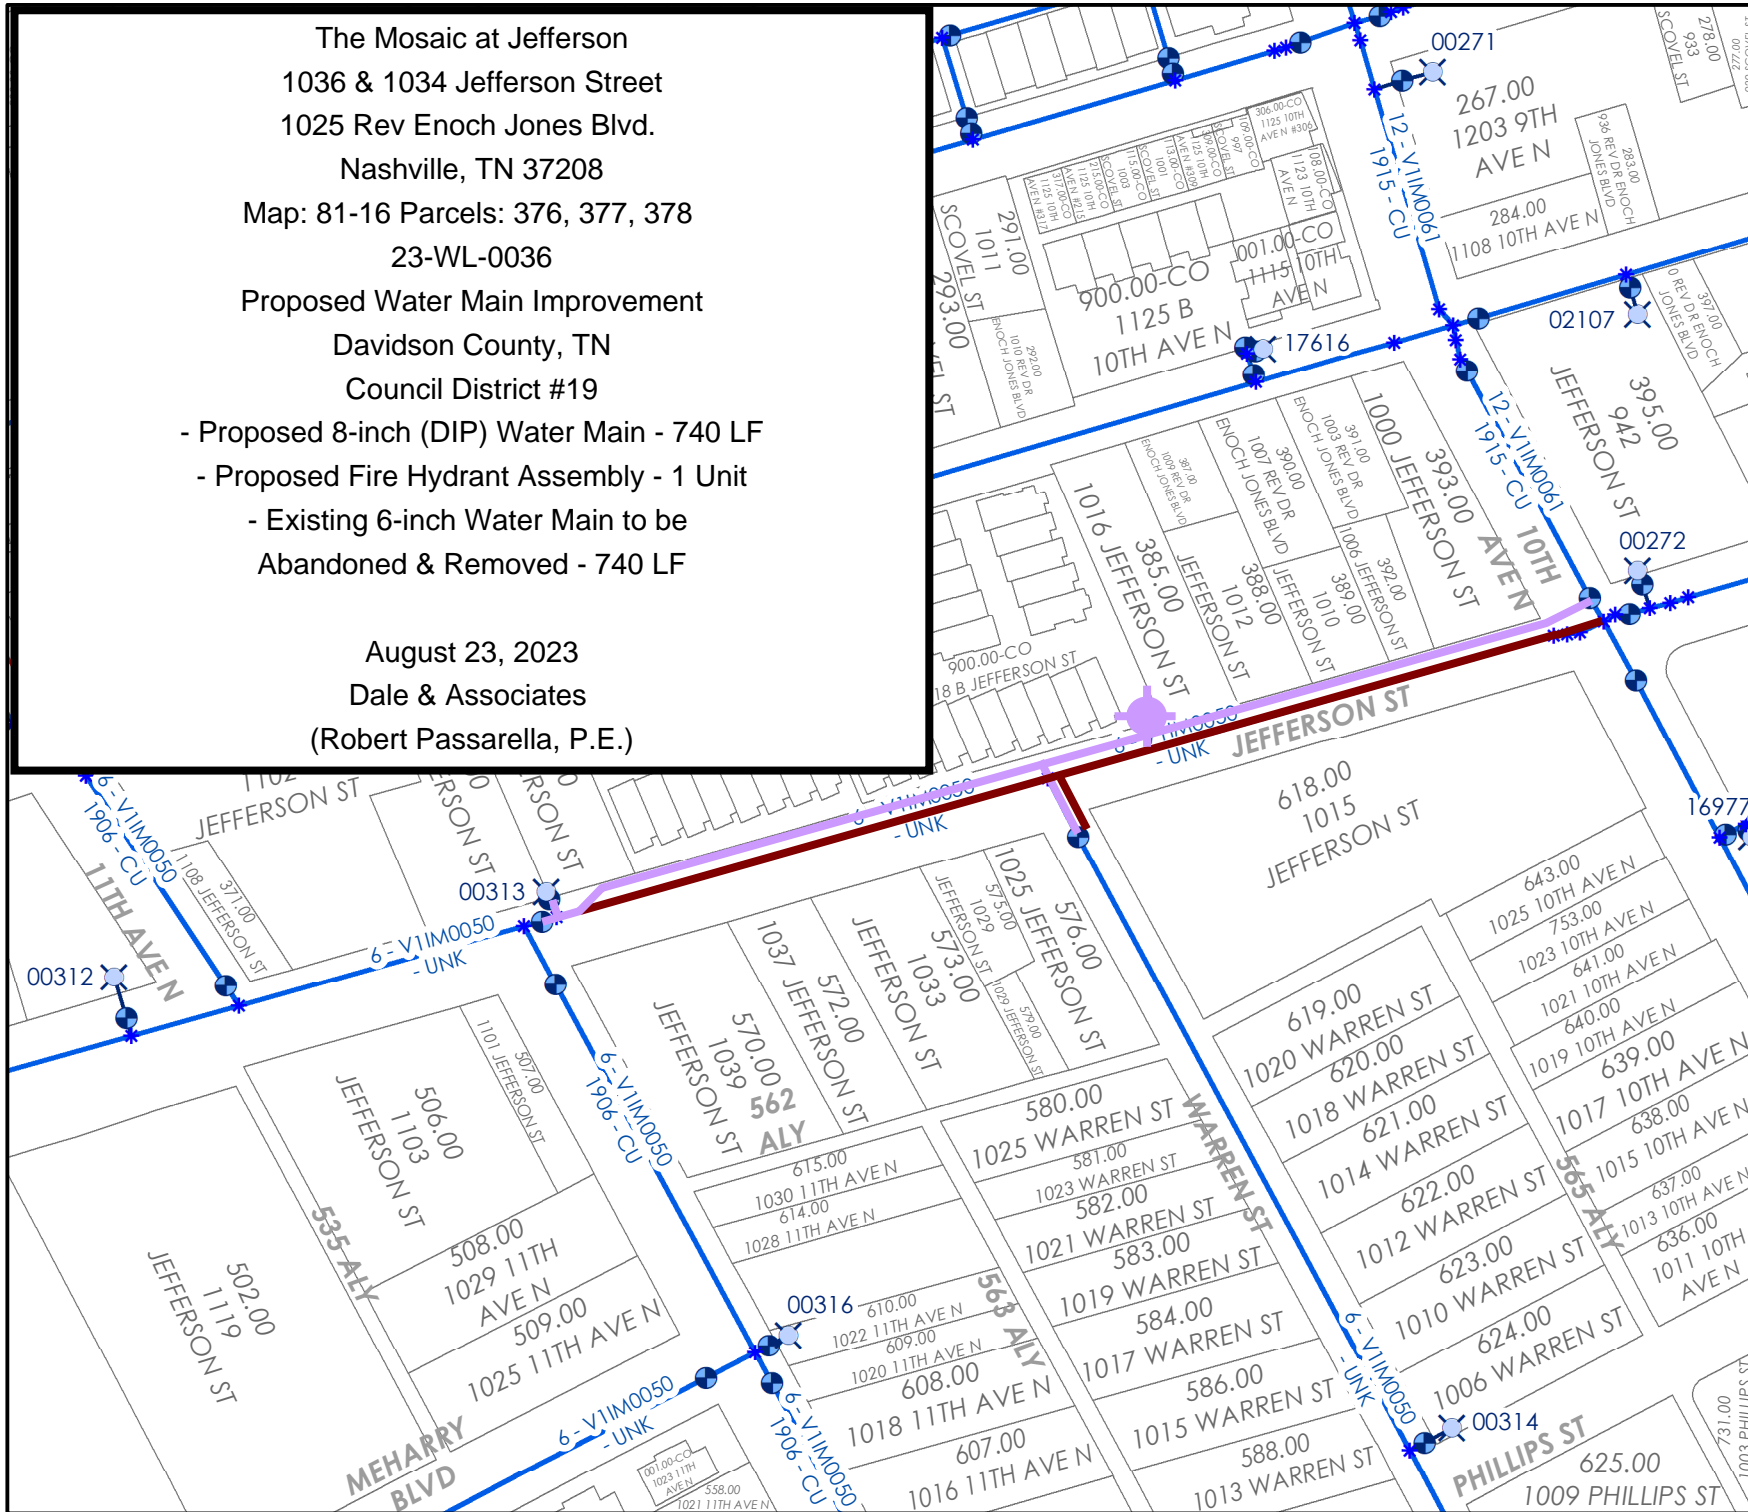

North Arrow
Not to Scale
Date: 8/23/2023



--- CAUTION ---
THE POSITION OF THE
WATER AND SANITARY
SEWER MAINS SHOWN
ARE APPROXIMATE AND
ARE INTENDED TO
SHOW THE GENERAL
LOCATIONS ONLY.
THE SIZES NOTED ARE
TO THE BEST OF MWS
KNOWLEDGE. IN ALL
CASES WHERE PRECISE
LOCATION AND MAIN
SIZES ARE REQUIRED,
FIELD VERIFICATION
WILL BE NECESSARY.



Legend

Fitting STATUS

- Abandoned (Red star symbol)
- In Service (Blue star symbol)

Hydrant STATUS

- In Service (Blue hydrant symbol)

System Valve STATUS

- In Service (Blue valve symbol)

Main

- Abandoned (Red line)
- In Service (Blue line)

Hydrant Lead

- Hydrant Lead (Blue line)