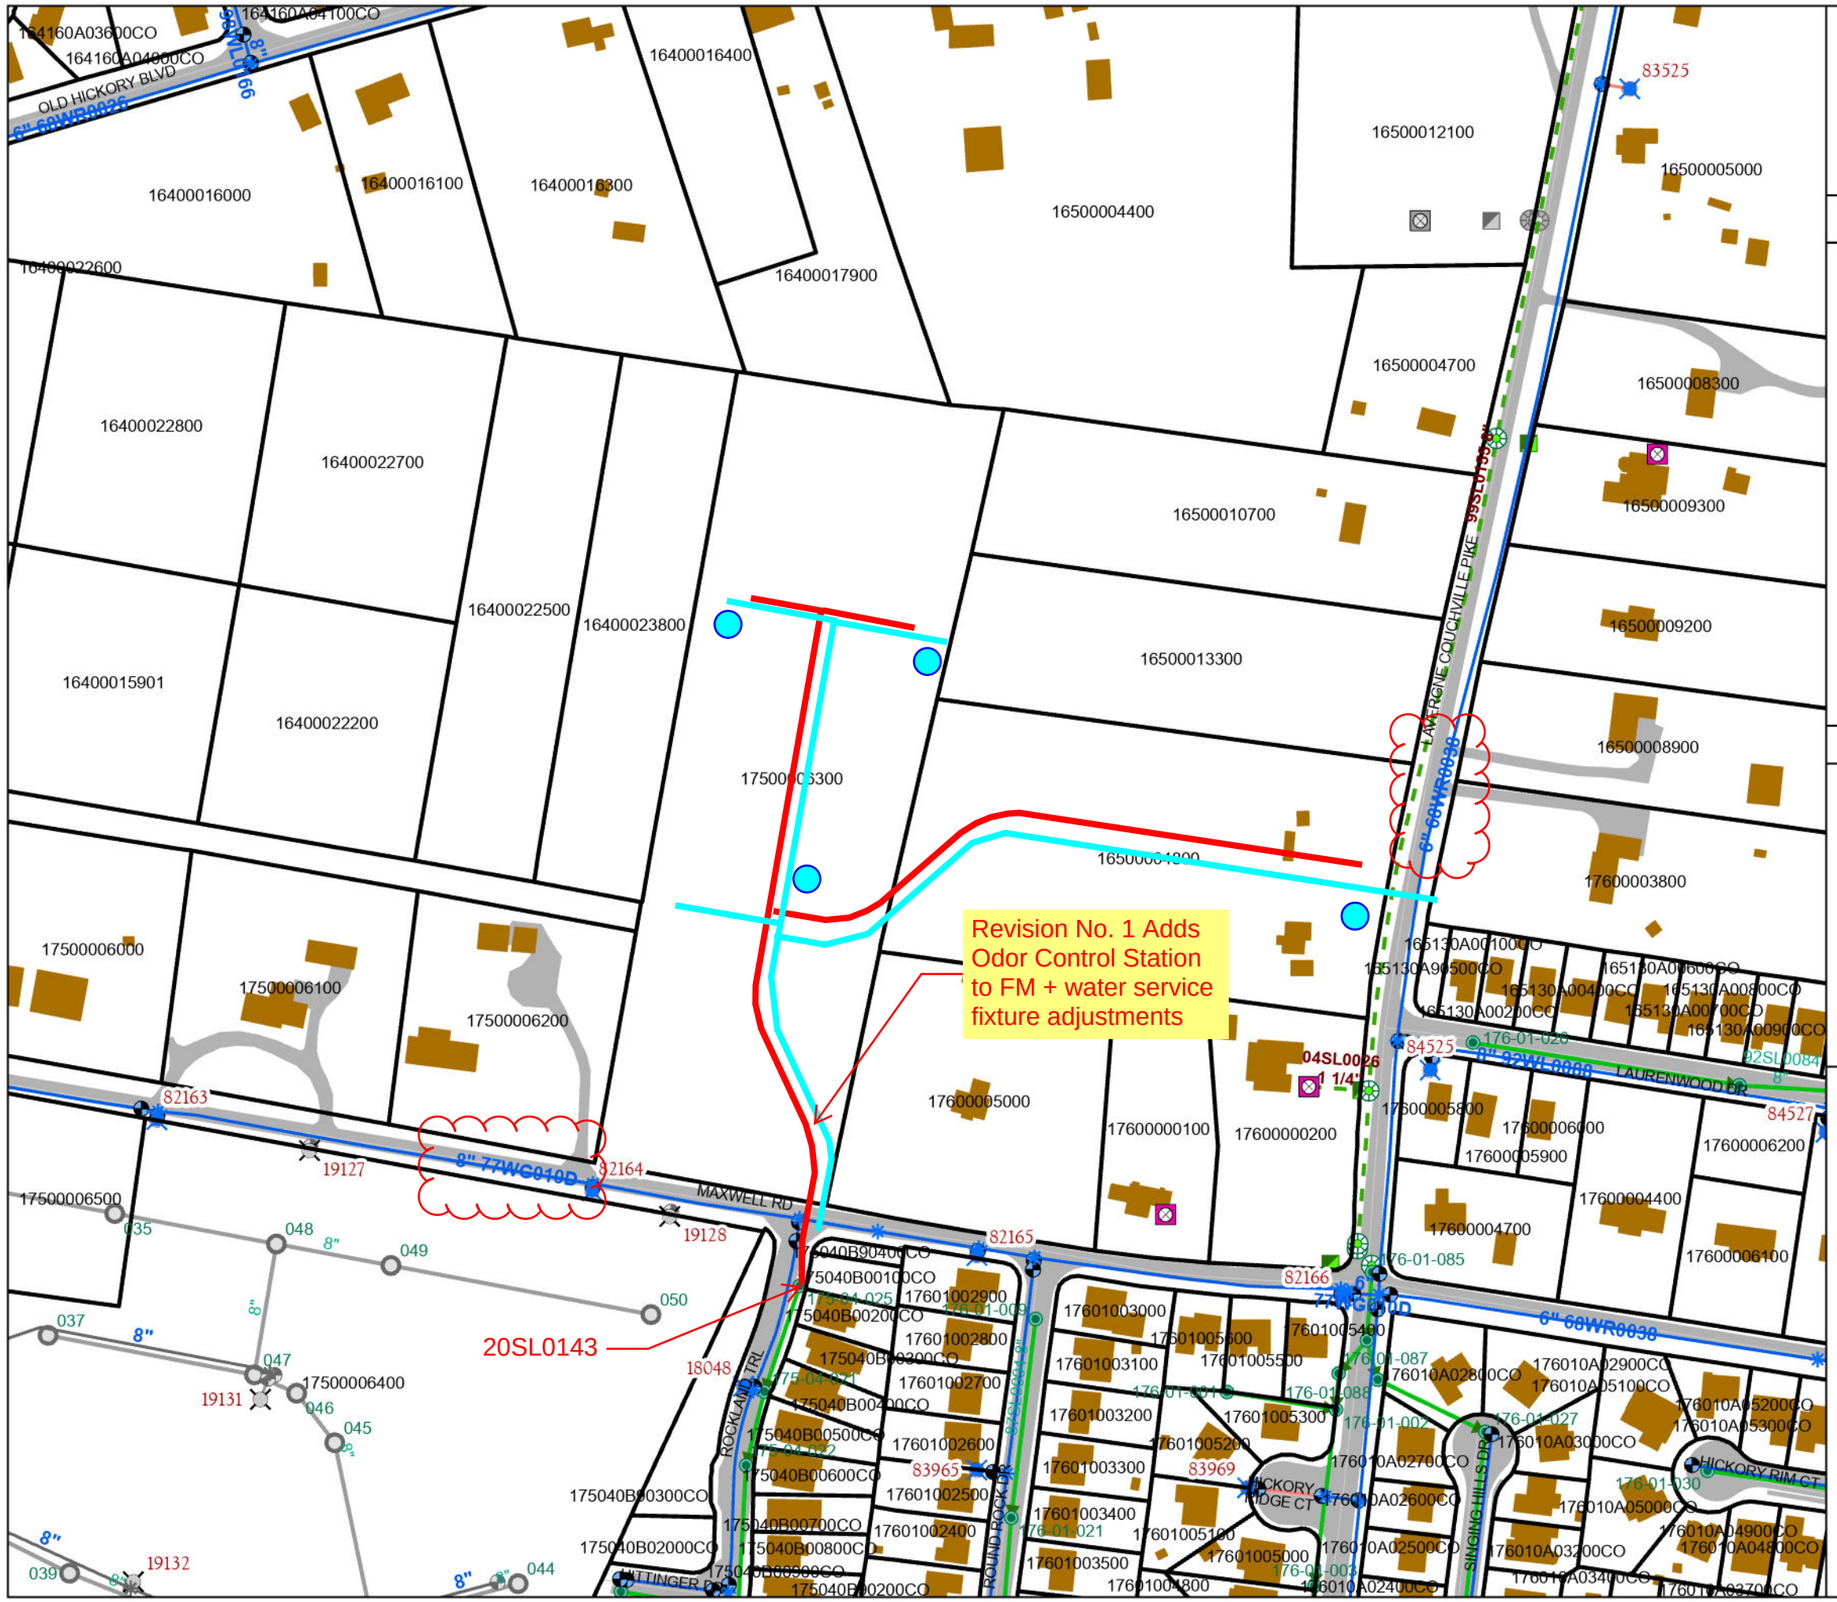

Martin's Grove (Revision 1)
25WL0054
25SL0123

LEGEND

2,220 linear feet of 8-inch water main (DIP)
(4) fire hydrant assemblies
474 linear feet of 3-inch sanitary force main (PVC)
1,515 linear feet of 2-inch sanitary force main (PVC)
1 Odor Control Station

X AND ASSOCIATED EASEMENTS

DATE: 6/25/26

ENGINEERING FIRM: Catalyst Design Group
ENGINEER: Jack Parker, PE

COUNCIL DISTRICT: 08
PARCEL NUMBERS: 16500004800 (new parcel)

- - - - CAUTION - - - -

THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

Scale: 1" = 200 ft

N

METRO WATER SERVICES